



2N IP Safety

Installation Manual



Table of Contents

Symbols and Terms Used	4
Product Description	5
Basic Features	5
Product Versions	6
Accessories	7
Accessories for Installation	7
Extenders	8
Power Supply	10
Licenses	10
Other accessories	11
Package Completeness Check	16
Installation	18
Mechanical Installation	18
Flush Mounting	20
Surface Installation	24
Electric Installation	25
Power Supply	25
Board Versions	26
Available switches	29
Relay Terminal Wiring Diagrams	30
LAN Connection	32
Grounding	33
Overvoltage Protection	34
Main and Extending Modules	36
Additional Switch	36
Security Relay	40
Induction Loop external	42
Grounding	43
Installation Completion	44
Brief Guidelines	45
Device Configuration Interface Access	45
Domain Name	45
IP address	45
Web Configuration Interface Login	45
Recommended browsers	46
Configuration via Hardware	46
Device Restart	46
IP Address Retrieval Using Hardware	46
Static IP Address Setting with RESET Button	47
Dynamic IP Address Setting via RESET	47
Factory Default Reset with RESET Button	48
IP Address Retrieval	48
IP Address Retrieval Using 2N IP Utility	48
IP Address Retrieval Using Hardware	50
IP Address Retrieval Using Speed Dial Button	50
Device Static/Dynamic IP Address Switching with Speed Dial Button	51
Device Restart	51
Restart Using RESET Button	51
Restart Using Web Configuration Interface	51
Firmware Update	51
Factory Default Reset with RESET Button	52
Factory Default Reset (version 555v3)	52
Factory Default Reset (version 555v2)	52

Call Connection	53
Troubleshooting	55
Technical Parameters	56
General Drawings	59
Surface Installation	59
Flush mounting – into plasterboard	59
General Instructions and Cautions	61
Directives, Laws and Regulations	61
EU	61
Industry Canada	62
Legislation of Thailand	62
Electric Waste and Used Battery Pack Handling	62

Symbols and Terms Used

The following symbols and pictograms are used in the manual:



DANGER

Always abide by this information to prevent persons from injury.



WARNING

Always abide by this information to prevent damage to the device.



CAUTION

Important information for system functionality.



TIP

Useful information for quick and efficient functionality.



NOTE

Routines or advice for efficient use of the device.

Product Description

In this section, we introduce the **2N IP Safety** product, outline its application options and highlight the advantages following from its use.

Basic Features

2N IP Safety is a highly durable and reliable IP intercom equipped with a number of useful features that are not common in devices in this category. Thanks to the SIP standard support and compatibility with renowned IP PBX and phone manufacturers, it can use all the VoIP network services.

2N IP Safety can work as a standard or emergency door access intercom for buildings, entrances to premises or garages, manufacturing halls, highways and so on.

The main advantages of this device are:

Two highly sensitive microphones and one speakerphone (up to 10 W) – thanks to an integrated acoustic echo cancelling (AEC) system, the product provides mutual audibility even if the calling persons are talking at the same time under normal conditions.

Speed Dial Buttons – can be provided with pre-programmed buttons. You can set up to three telephone numbers and time profiles for each of the buttons to increase the accessibility of the called party.


Electric Lock Switch – this switch can be controlled via a numeric keypad, PC application or any phone during a call. If necessary, the device can be supplemented with an additional switch module.

Device Installation – is very easy, all you have to do is connect the system into your LAN via a network cable. The device can be supplied either from a 12 V DC power source or using PoE if supported by your LAN.

Device Configuration – use a PC equipped with any Internet browser for configuration. Extensive installations can be easily managed in bulk using 2N Access Commander.

Other advantages of the device

Product Versions

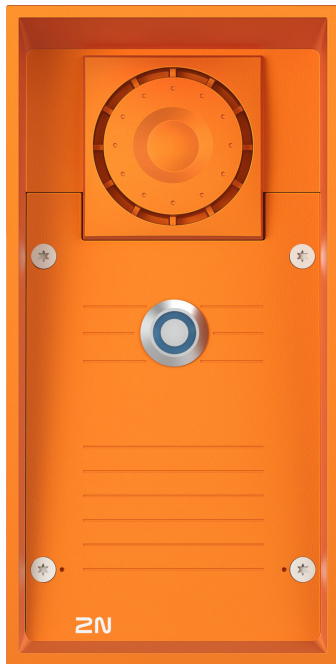

Part No. 9152101

Axis Part No. 01353-001

2N IP Safety main unit – 1 button, 10 W loudspeaker

- IP69K
- 1 button
- 10 W loudspeaker
- Control of two electric locks
- Additional switch connection option




Part No. 9152102W

Axis Part No. 01354-001

2N IP Safety main unit – 2 buttons, 10 W loudspeaker

- IP69K
- 2 buttons with INFO and SOS labels
- 10 W loudspeaker
- Control of two electric locks

Product Description

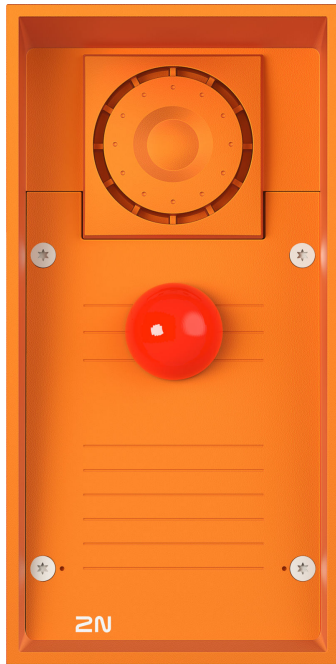

Part No. 9152101MW

Axis Part No. 01355-001

2N IP Safety main unit – 1 emergency button, 10 W loudspeaker

- 1 red emergency button
- 10 W loudspeaker
- Extra robust version
- Control of two electric locks
- Additional switch connection option


Accessories

Accessories for Installation

2N IP Safety is designed for both outdoor and indoor applications and requires no additional roof.

Choose the proper accessories for your particular installation needs.

All **2N IP Safety** units can be used without additional accessories for flush and surface installation, however, the appropriate mounting kit must be used for plasterboard or hollow brick masonry installations.



Part No. 9152000

Axis Part No. 01356-001

Flush mounting frame – orange version

Suitable for covering the device edge or flush or plasterboard installations.

Aluminum cast.



Part No. 9151001

Axis Part No. 01348-001

Flush mounting box for walls

The box material is stainless steel.

Product Description



Part No. 9151002

Axis Part No. 01349-001

Flush mounting box for plasterboard



Part No. 9151005

Axis Part No. 01351-001

Stand installation spacer

The spacer allows for installation to a height of 120 cm to the top device edge.



Part No. 9151007

Axis Part No. 01550-001

Double mounting spacer

The double spacer allows for double installation at heights of 115 cm and 203 cm to the top device edge.



Part No. 9151006

Axis Part No. 01352-001

Installation adapter (US)

Extenders



Part No. 9151010

Axis Part No. 01350-001

Additional Switch

Allows you to control another appliance (active output of 12 V DC / max. 600 mA) or such non-critical equipment as lights (passive relay output of 30 V / 1 A for an indefinite time).

It also comes with a tamper switch indicating that the **2N IP Safety** front panel is open.

Product Description



Part No. 9159050

Axis Part No. 01391-001

External Induction Loop

The external induction loop transmits sound wirelessly from **2N IP Safety** to the hearing aids of the people with hearing disabilities and enables them to hear and perceive sounds better.



Part No. 9159010

Axis Part No. 01386-001

Security Relay

A handy add-on that significantly enhances security. It prevents lock tampering.

To be installed between the protected device from which it is also powered and the lock controlled by it.



Part No. 9159011

Axis Part No. 01387-001

Wiegand Isolator

The Wiegand isolator is designed for galvanic isolation of two separately supplied devices interconnected via a Wiegand bus.

The Wiegand isolator protects the interconnected devices against communication errors and/or damage.



Part No. 9155198SET

Axis Part No. 01975-001

Security Package for 2N Devices

The security package provides increased door security.

The safety package includes a safety relay, a protection switch and an I/O module.

Power Supply



Part No. 91378100E (with EU cable)

Part No. 91378100US (with US cable)

Axis Part No. 01403-001

One-port PoE injector

For intercom supply via Ethernet cable where the PoE switch is absent.



Part No. 91341481E (with EU cable)

Part No. 91341481US (with US cable)

Axis Part No. 02520-001

Stabilized 12 V / 2 A power supply

The supply must be used where PoE is not used.



Part No. 932928

Axis Part No. 02529-001

12 V transformer

For 230 V mains voltage.

Designed for external supply of electric locks.



Part No. 9159052

Axis Part No. 01393-001

12 V / 1 A power supply for 2N Induction Loop

The external induction loop power supply has 230 V AC input voltage and 12 V DC output voltage.

Licenses



Part No. 9137909

Axis Part No. 01380-001

Gold License

Includes the Enhanced Video, Enhanced Integration and Lift Control licenses.

Product Description



Part No. 9137910

Axis Part No. 01381-001

InformaCast License



Part No. 9137921

Axis Part No. 03160-001

MS Teams license



TIP

- Refer to the Configuration Manual for 2N IP Intercoms, Subs. [Function Licensing](#) for details.
- Please refer to the local 2N distributor for more accessories and recommendations.

Other accessories



Part No. 9159013

Axis Part No. 02523-001

Departure button

The departure button is connected to the device logic input for opening the door from inside the building.



Part No. 9159012

Axis Part No. 01388-001

Magnetic door contact

Set for installation on a door, enabling the status of door opening to be ascertained. Used where the device is used for door protection, open door detection or forced opening.

Product Description

Part No. 9134173

Axis Part No. 01384-001

MIFARE RFID chip card, 13.56 Hz

RFID chip card, MIFARE Classic 1k, 13.56 MHz.



Part No. 9134174

Axis Part No. 01385-001

MIFARE RFID chip fob, 13.56 MHz

RFID chip fob, MIFARE Classic 1k, 13.56 MHz.



Part No. 9134165E

Axis Part No. 01395-001

EM RFID chip card, 125 Hz

RFID chip card, type EM4100, 125 kHz.



Part No. 9134166E

Axis Part No. 01396-001

EM RFID chip fob, 125 kHz

RFID chip fob, type EM4100, 125 kHz.



Part No. 11202601


Axis Part No. 02787-001

MIFARE DESFire RFID chip card, 13.56 MHz

RFID chip fob, type MIFARE DESFire EV3 4 K, 13.56 MHz (ISO/IEC14443A).

Suitable for data encryption in PICard Commander.

The package includes 10 pieces.



Product Description



Part No. 11202602

Axis Part No. 02788-001

MIFARE DESFire RFID fob, 13.56 MHz

RFID fob, type MIFARE DESFire EV3 4 K, 13.56 MHz (ISO/IEC14443A).

Suitable for data encryption in PCard Commander.

The package includes 10 pieces.



Part No. 9137420E

Axis Part No. 01399-001

External RFID reader, 125 kHz

External RFID card reader connectable to a PC via a USB interface.

Suitable for system administration and adding of EM41xx cards (125 kHz) using the device web configuration or PCard Commander.

Product Description



Part No. 9137421E

Axis Part No. 01399-001

External RFID reader, 13.56 MHz + 125 kHz, NFC/HCE

External RFID card reader connectable to a PC via a USB interface.

Suitable for system administration and adding of 13.56 MHz/125 kHz cards and Android devices with NFC/HCE support using the device web configuration or the Access Commander.

Suitable for uploading of MIFARE DESFire cards into the PICard Commander encryption application.

The following RFID cards can be read:

Supported RFID cards 125 kHz:

- EM4x02
- NXP HiTag2

Supported RFID cards 13.56 MHz:

- **ISO14443A** (MIFARE Classic, MIFARE Plus, MIFARE Mini, MIFARE Ultralight, MIFARE DESFire CSN only)
- **PicoPass** (HID iClass CSN, Picopass)
- **FeliCa** (Standard, Lite)
- **ST SR** (SR, SRI, SRIX)
- **My2N**
- **2N PICard**

The device can also read the 13.56 MHz 2N PICard RFID cards.

Product Description

Part No. 9137424E



Axis Part No. 01527-001

External secured RFID reader, 13.56 MHz + 125 kHz, NFC/HCE

External secured RFID card reader connectable to a PC via a USB interface.

Suitable for system administration and adding of 13.56 MHz/125 kHz cards and Android devices with NFC/HCE support using the device web configuration or the Access Commander.

Suitable for uploading of MIFARE DESFire cards into the PICard Commander encryption application.

The following RFID cards can be read:

Supported RFID cards 125 kHz:

- EM4x02
- HID Prox

Supported RFID cards 13.56 MHz:

- **ISO14443A** (MIFARE Classic, MIFARE Plus, MIFARE Mini, MIFARE Ultralight, MIFARE DESFire CSN only)
- **PicoPass** (HID iClass CSN, Picopass)
- **FeliCa** (Standard, Lite)
- **ST SR** (SR, SRI, SRIX)
- **HID PAC** (HID SEOS, HID iClass SE, iClass SR, HID MIFARE DESFire with SIO, HID MIFARE Classic with SIO)
- **My2N**
- **2N PICard**

Part No. 9137410E



Axis Part No. 01397-001

External IP relay, 1 output

Stand-alone IP relay, which can be controlled from an intercom via HTTP commands and helps control devices from an unlimited distance.

Product Description

Part No. 9159014EU/US/UK



Axis Part No. 01404-001

2N 2Wire (set of 2 adaptors and power source for EU/US/UK)

The 2N 2Wire converter allows you to use the existing 2-wire cabling from your original doorbell or door intercom for connecting any IP device. You do not have to configure anything, all you need is one 2N 2Wire unit at each end of the cable and a power supply connected to at least one of these units. The 2N 2Wire unit then provides PoE power not only to the second converter, but to all of the connected IP end devices.

Package Completeness Check

Please check the product delivery before installation. Contents:

1x **2N IP Safety**

1x Certificate of ownership

1x Brief Manual

1x installation drilling template

1x Torx 10 / Torx 20 double-ended wrench

1x Bushings (enclosed):

- 1x spare sealing for big bushing for a thick cable, one hole
 - 1 big blank with nut
-

2x Frame fitting

1x Grounding terminal with a screw

4x 5 x 80 mm screw

4x "Intelligent" dowel (8 x 50 mm)



NOTE

- The flush mounting frame is not included – it is sold separately as Part No. 9152000.
- Bushing set is the same as for 2N IP Safety, but bushings are already mounted.

Installation

Mechanical Installation

Installation Conditions

Make sure that the following 2N IP Safety installation conditions are met.

- There must be enough space for the device installation.
- Make sure that the dowel holes have the required diameter. If the diameters are too large, the dowels may get loose! Use the mounting glue to secure the dowels if necessary.
- Do not use low-quality dowels to avoid their falling out of the wall!
- Make sure that the depths of the dowel holes are accurate! The plugs are 50 mm long and the screws are 90 mm long.
- Stainless steel screws are used for the **2N IP Safety** assembly. Other screws than stainless steel ones corrode soon and may aesthetically deteriorate the surrounding environment!
- Before starting the mechanical installation on a selected place, make sure carefully that the preparations associated with it (drilling, wall cutting) cannot damage the electrical, gas, water and other existing wires and pipes.
- The device is not designed for environments with increased vibrations such as means of transport, machine rooms and so on.
- The device may not be exposed to aggressive gas, acid vapors, solvents, etc.
- The device is not intended for direct connection into the Internet/WAN. The device must be connected to the Internet/WAN via a separating active network element (switch/router).
- Having removed the front panel, make sure that no dirt gets inside the product, especially onto the sealing surface and microphone wave guides.



NOTE

The microphone sound guides are normally loose after the front panel is removed! The screw is only used as a fall-out protection during installation.

- Avoid strong electromagnetic radiation on the installation site.
- Make sure that the VoIP connection is configured properly according to the SIP and other VoIP recommendations.



WARNING

Be sure to keep strictly the hole dimensions while mounting the device into classic bricks without the flush mounting box as shown in the picture with dimensions.



CAUTION


- When the proper installation instructions are not met, water might get in and destroy the electronics. As the device circuits are constantly under voltage water leakage causes electrochemical reaction. The manufacturer's warranty shall be void for products damaged in this way!
- The warranty does not apply to the product defects and failures arisen as a result of improper installation (in contradiction herewith). The manufacturer is neither liable for damage caused by theft within an area that is accessible after the attached electric lock is switched on. The product is not designed as a burglar protection device except when used in combination with a standard lock, which has the security function.
- Exceeding the allowed operating temperature may not affect the device immediately but leads to premature ageing and lower reliability. For the acceptable range of operating temperatures and relative humidity values refer to S.[Technical Parameters \(p. 56\)](#).
- Any intentional mechanical damage to the device (drilling, main unit tampering, etc.) results in a loss of warranty.
- The device installation and setting should only be performed by professionally qualified persons.

Installation Tips

- The recommended height is 135 cm for standard installations (100–120 cm for disabled persons) from the floor to the device camera level. The installation heights may vary depending on the device use.
- The mounting box can be purchased in advance. Thus, a building company can be commissioned to do the rough work. The mounting box also helps you put your device exactly in the vertical position (with a max deviation of 2 ° while walling in).

Flush Mounting

Flush mounting – into classic masonry

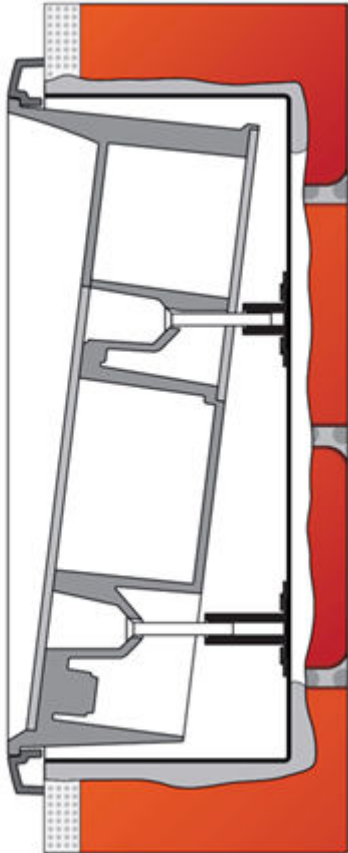

What you need for mounting:

- **2N IP Safety**
- a properly cut hole as instructed in the box package (131 x 222 x 82 mm)
- flush mounting box for walls (9151001, 01348-001)
- flush mounting frame (9152000, 01356-001)

If you use the brick flush mounting box, follow the instructions below:

1. Make a hole using the template. Suppose that all the required cables have been carried into the hole.
2. Put the flush mounting box inside for testing purposes to make sure that the hole is deep enough and the uneven hole edge is perfectly covered with the frame.
3. If the hole is perfect, wall in the flush mounting box.
4. Remove the front panel from the device.
5. Select the holes for cable supply. Insert the included blanks into the other holes. Apply the cable bushings or a suitable sealant to prevent penetration of insects or water. You can also insert the small bushing in the device bottom hole.
6. Attach the frame to the device.
7. Place the device into the flush mounting box while introducing the cables. Leave some of the cables inside the device as a reserve and keep the rest under the device bottom.

8. Insert the supplied screws in the side mounting holes making sure that they penetrate into the flush mounting box nuts. Tighten all the screws properly.




WARNING

Keep the maximum tightening torque of 1.5 Nm. Be careful, the screw tightening sequence may affect the device position.

9. It is recommended that the frame – wall gap is sealed with silicone or another sealant. This prevents water leakage behind the device.

Do not complete mounting until you have finished electrical installation.

Flush mounting – into insulated facade

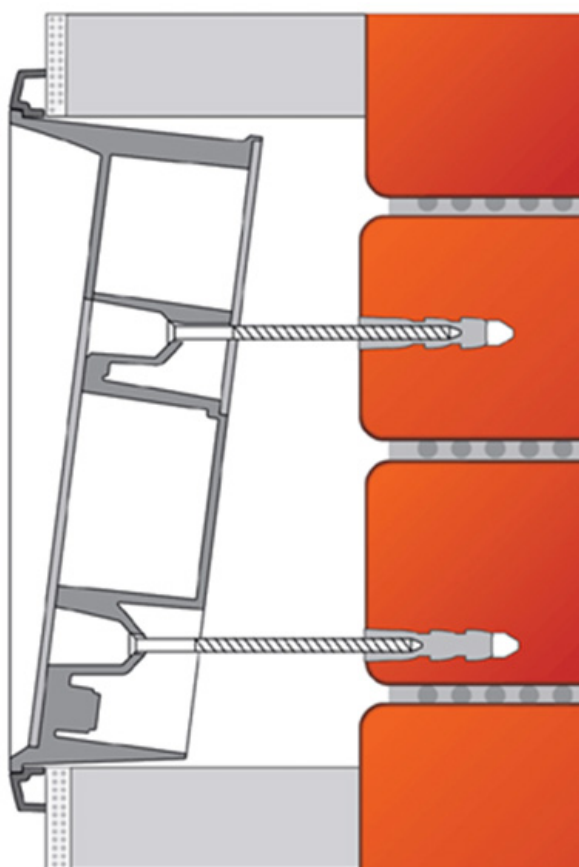

What you need for mounting:

- **2N IP Safety**
 - a properly cut hole as instructed in the box package (135 x 243,5 x 85 mm)
 - longer screws (depending on the thermal insulation thickness)
 - flush mounting frame (9152000, 01356-001)
1. Cut out the thermal insulation layer using the template (the same as for classic brick wall). Suppose that all the required cables have been carried into the hole.
 2. Put the device inside for testing purposes to make sure that the hole is deep enough and the uneven hole edge is perfectly covered with the frame.
 3. Remove the front panel from the device.

4. Select the holes for cable supply. Insert the included blanks into the other holes. Apply the cable bushings or a suitable sealant to prevent penetration of insects or water. You can also insert the small bushing in the device bottom hole.
5. Attach the frame to the device.
6. Place the device into the flush mounting box while introducing the cables. Leave some of the cables inside the device as a reserve and keep the rest under the device bottom.
7. Insert the supplied screws in the side mounting holes making sure that they penetrate into the flush mounting box nuts. Tighten all the screws properly.



WARNING

Keep the maximum tightening torque of 1.5 Nm. Be careful, the screw tightening sequence may affect the device position.

8. It is recommended that the frame – wall gap is sealed with silicone or another sealant. This prevents water leakage behind the device.

Do not complete mounting until you have finished electrical installation.



CAUTION

- The hole depth depends on the insulation layer thickness. If the insulation layer is rather thick, you may need longer screws! If there are hollow bricks under the insulation, make sure that your screws pass through the whole dowel (50 mm)! Otherwise, the dowel does not hold in a hollow brick.
- Make sure that the dowel holes have the required diameter. If the diameter is too large, the dowels may get loose! Use the mounting glue to secure the dowels if necessary.
- Make sure that the depths of the dowel holes are accurate! The dowel length is 50 mm and the screw length is 90 mm.

Flush installation – in a hollow brick


What you need for mounting:

- **2N IP Safety**
- a properly cut hole as instructed in the box package (131 x 222 x 82 mm)
- flush mounting box for walls (9151001, 01348-001)
- flush mounting frame (9152000, 01356-001)



WARNING

Note that the external side of the bricks gets damaged by cutting and the dowels cannot practically be fixed into the thin internal part of the bricks. Therefore, use the wall flush mounting box and follow the instructions for this box.

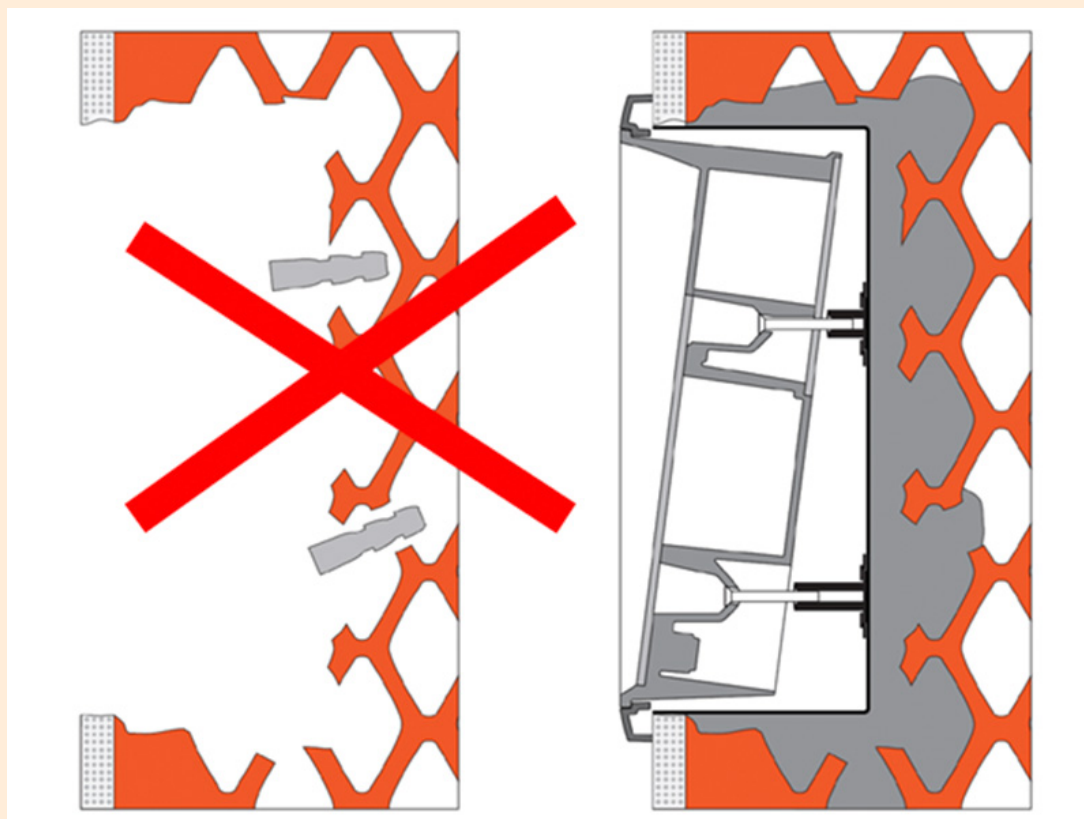

If you use the brick flush mounting box, follow the instructions below:

1. Make a hole using the template. Suppose that all the required cables have been carried into the hole.
2. Put the flush mounting box inside for testing purposes to make sure that the hole is deep enough and the uneven hole edge is perfectly covered with the frame.
3. If the hole is perfect, wall in the flush mounting box.
4. Remove the front panel from the device.
5. Select the holes for cable supply. Insert the included blanks into the other holes. Apply the cable bushings or a suitable sealant to prevent penetration of insects or water. You can also insert the small bushing in the device bottom hole.
6. Attach the frame to the device.
7. Place the device into the flush mounting box while introducing the cables. Leave some of the cables inside the device as a reserve and keep the rest under the device bottom.
8. Insert the supplied screws in the side mounting holes making sure that they penetrate into the flush mounting box nuts. Tighten all the screws properly.



WARNING

Keep the maximum tightening torque of 1.5 Nm. Be careful, the screw tightening sequence may affect the device position.

9. It is recommended that the frame – wall gap is sealed with silicone or another sealant. This prevents water leakage behind the device.

Do not complete mounting until you have finished electrical installation.


Flush mounting – into plasterboard

What you need for mounting:

- **2N IP Safety**
- a properly cut hole as instructed in the box package (116 x 233 x 78 mm)
- flush mounting box for plasterboards (9151002, 01349-001)
- flush mounting frame (9152000, 01356-001)

Use the flush mounting box for plasterboards and follow the instructions for this box.

Surface Installation

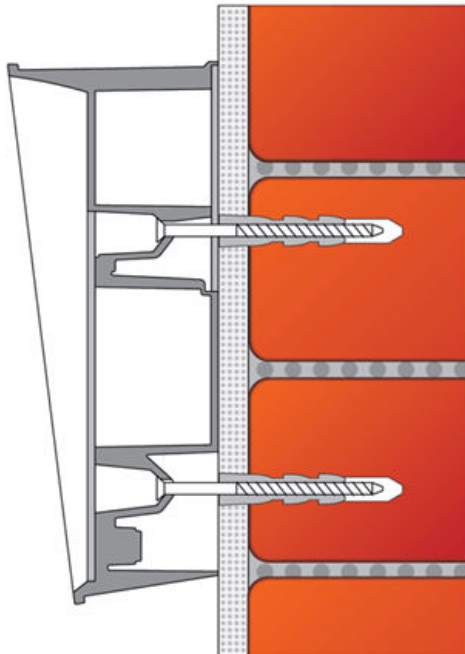

What you need for mounting:

- **2N IP Safety**



WARNING

Eliminate the risk of personal injury! Surface installation is not recommended for narrow passages or places where people's attention is distracted by something else. The manufacturer shall not be liable for injuries in such cases!



CAUTION

- If the device is installed in locations with an increased risk of damage (e.g., in public garages or in areas prone to vandalism), replace the supplied dowels and screws with steel anchoring elements.
- Be sure to insert plugs into unused bushing holes to avoid water leakage during facade cleaning, for example. Never leave the holes open for even a short time (one day delay between mounting and cable connection, e.g.).



TIP

Download the [drilling template](#) from 2N.com.

1. Select position with respect to the supply cables. Where the cables are installed inside a structure or wall, use the hole at the device bottom.
2. Drill holes of the depth of 70 mm for dowels in the wall as shown in the figure. Push or hammer the enclosed dowels into the drilled holes. Use some suitable building adhesive if the dowels are too loose. Use fixing elements of your own for steel structure surface mounting (metric screws + nuts, e.g.).
3. Remove the front panel from the device.
4. Select the holes for cable supply. Select and mount the bushings depending on the cables: 2-hole bushing or 1-hole bushing or both. Insert the included blanks into the other holes.
5. Put the device on the wall/structure while introducing cables inside. Leave some of the cables inside as a reserve. Insert the plugs in the unused bushings and tighten the bushing nuts carefully.
6. Do not complete mounting until you have finished electrical installation – refer to Mounting Completion. Where cables lead along the surface, use the bushings included in the delivery.

Electric Installation

Power Supply

2N IP Safety can be fed either directly from the LAN if equipped with PoE 802.3af (Class 0, max. 12,95 W) supporting network elements or from an external 12 V / 1 A DC power supply.



CAUTION

- The device must be part of the electrical system of the building.
- The external power supply should comply with PS2/LPS.

PoE Supply

2N IP Safety is compatible with the PoE 802.3af (Class 0, max. 12,95 W) technology (Class 0, max. 12.95 W) and can be supplied directly from the LAN via compatible network elements. If your LAN does not support this technology, insert a PoE injector, between **2N IP Safety** and the nearest network element.

External Power Supply

Use a SELV supply 12 V dimensioned to the current consumption feeding of at least 4A to make your device work reliably.

**CAUTION**

Make sure that the wires are firmly attached to the terminal to avoid any free contact.

Adapter Connection (1341481, 02520-001)

The white wire at the end of the adapter carries the positive charge (+), the black wire carries the negative charge (-).

Combined Power Supply**Board Versions**


This subsection includes diagrams showing the main PCB connectors for different board versions.

The figures below show the layout of connectors on the printed circuit board (PCB). Cables, accessories and other system components are connected to connectors X1 through X22 shown in the figures.


Connector	Description
X1	Speaker
X4	Camera module
X5	Button 1
SW1	Reset button (PCB version 555v3 and higher)
X6	Configuration jumpers
X7	Induction loop output Connector type JST SHR-02V-S
X8	Extending module (RFID card reader or additional switch)
X10	Buttons 1 through 4
X11	LAN connection
X12	Servicing connector
X13	Keypad module

Connector	Description
X15	Left-hand microphone
X16	Right-hand microphone
X17	Relay NO and NC contacts max. 30 V / 1 A AC/DC. Used for connection of non-critical devices only (lights, e.g.).
X18	Switched output 12 V, max. 600 mA.
X19	12 V / 1 A DC power input
LED1/2	System status indicators are displayed
LED3	LAN connection activity


2N IP Safety – version 555v2

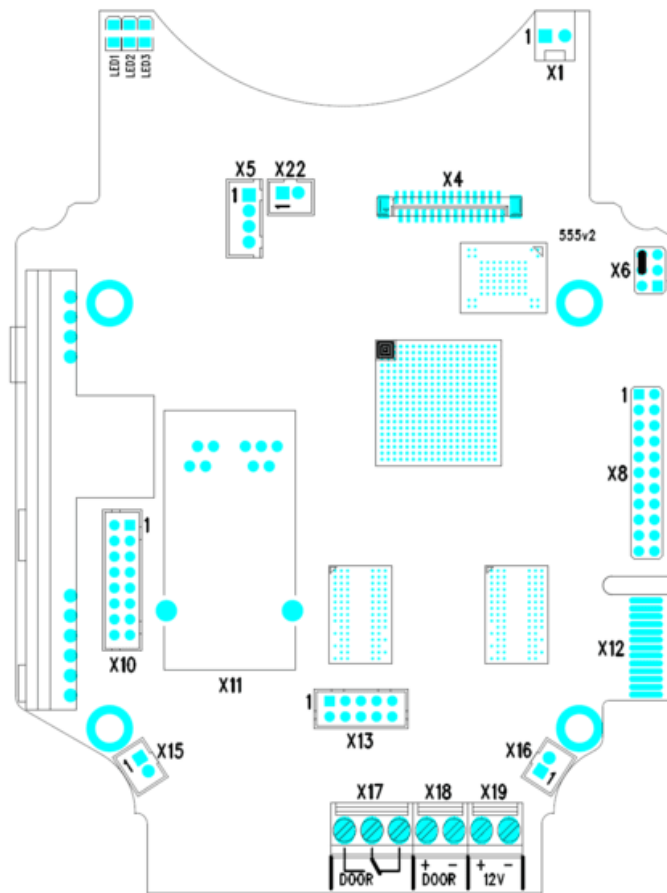

2N IP Safety – version 555v3

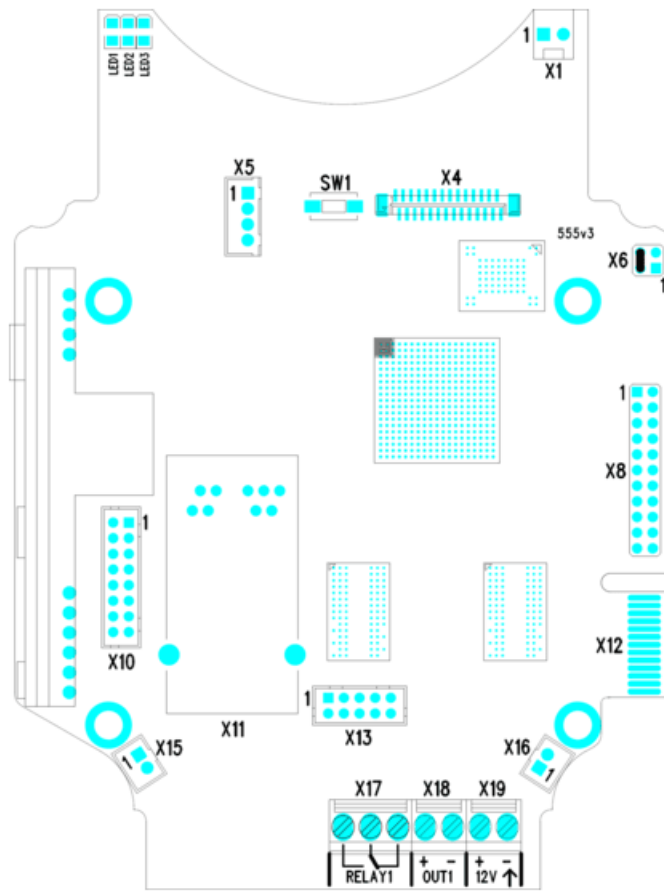

2N IP Safety – version 555v5

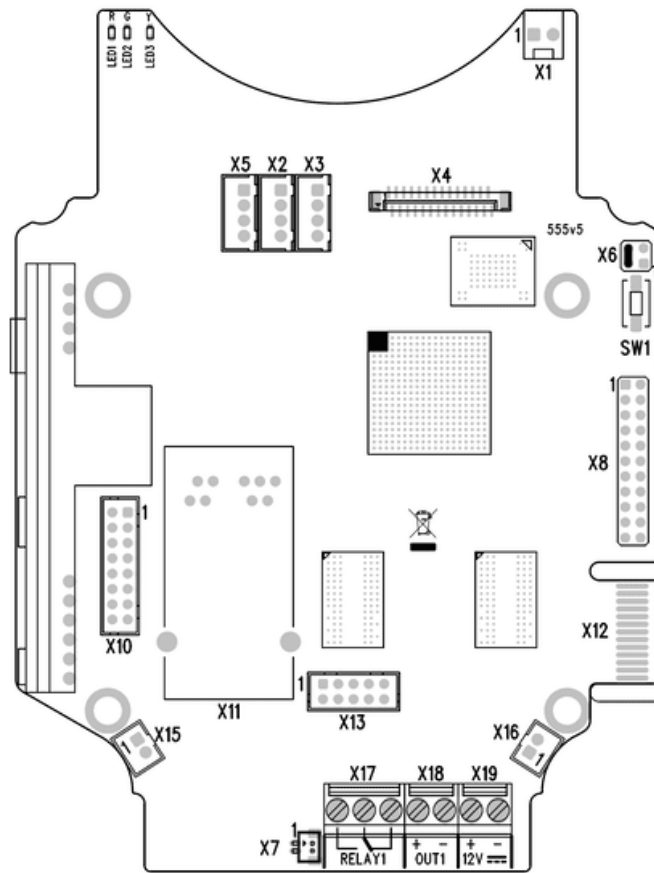

Available switches


Location	Name	Description
Main unit	RELAY1	<p>Passive switch:</p> <ul style="list-style-type: none"> • NO contact • max. 30 V / 1 A AC/DC • only used to connect non-critical devices (e.g. lights)
	OUTPUT1	<p>Active switch output:</p> <ul style="list-style-type: none"> • 8 – 12 V DC depending on the power supply, max. 600 mA • PoE: 11.6 V • adapter: source voltage -0.4 V

Location	Name	Description
Additional switch (9151010, 01350-001)	RELAY2	<p>Passive switch:</p> <ul style="list-style-type: none"> • make and break contact • max. 30 V / 1 A AC/DC • only used to connect non-critical devices (e.g. lights)
	OUTPUT2	<p>Active switch output:</p> <ul style="list-style-type: none"> • 8 – 12 V DC depending on the power supply, max. 600 mA • PoE: 11.6 V • adapter: source voltage -0.4 V



DANGER

If a coil containing device is connected, e.g. relays/electromagnetic locks, it is necessary to protect the device output against voltage peak while switching off the induction load. For this way of protection we recommend a 1 A / 1000 V diode (e.g., 1N4007, 1N5407, 1N5408) connected antiparallel to the device.

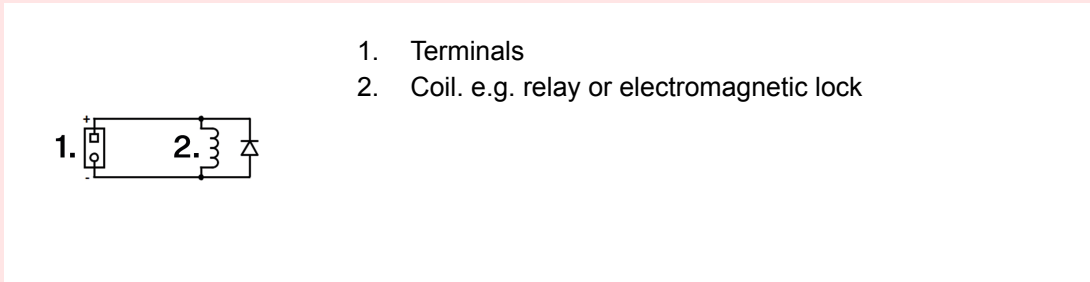

1. Terminals
2. Coil. e.g. relay or electromagnetic lock



WARNING

The 12V output is used for lock connection. If the device is installed in a location where there is a danger of unauthorized access (building front, e.g.), we strongly recommend the use of the 2N Security Relay (9159010, 01386-001) to ensure the maximum installation security.


Relay Terminal Wiring Diagrams


It is possible to connect a device to the **2N IP Safety** relay terminals to be controlled by this relay, e.g. an electric/electromechanical door lock.

The elements are designated as follows in the diagrams below:

1. Device relay
2. Controlled device

Wiring diagram for closing the electric circuit of the controlled device

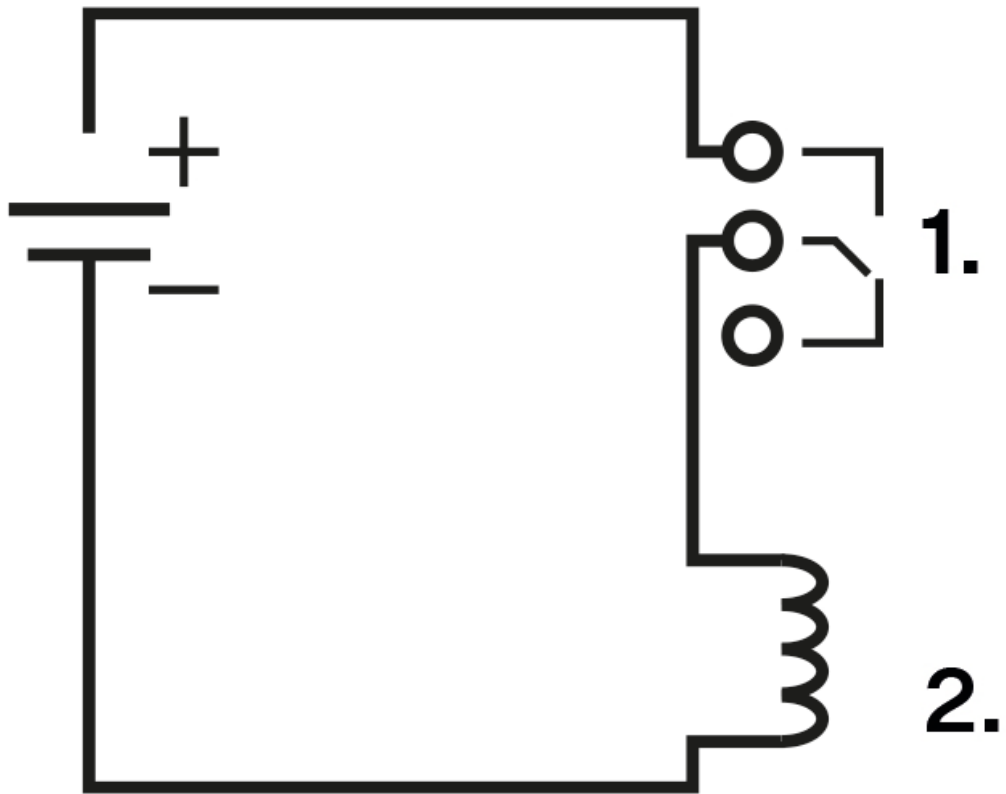

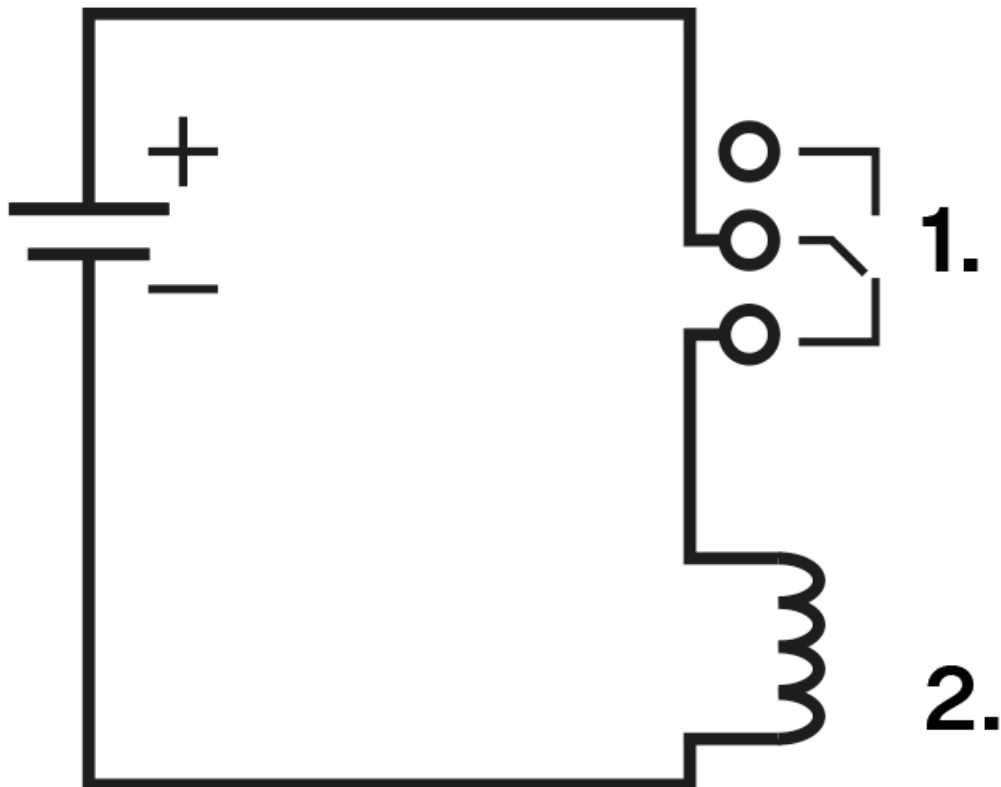Wiring diagram for opening the electric circuit of the controlled device**LAN Connection**

2N IP Safety is connected to the LAN by inserting a SSTP cable (Cat-5e or higher) terminated with an RJ-45 plug into the marked LAN connector on the device (connector X11). As the device is equipped with the Auto-MDIX function, you can use either the straight or crossed cable version.

This device must be deployed within a network infrastructure that provides adequate protection against Denial-of-Service (DoS) attacks and similar network-based threats. The device does not include built-in protection against high-volume or malicious traffic and relies on the surrounding network environment—such as firewalls, intrusion prevention systems, or rate limiting—for defense. Failure to implement appropriate network security measures may lead to service degradation or unavailability. The equipment's user documentation shall contain a [description of all exposed network interfaces and all services exposed via network interfaces](#), which are delivered as part of the factory default state.



WARNING

On the first launch, the device must only be connected to a secure and trusted network that is fully under control of the user or administrator.

If the device is first configured on an insecure or public network, there is a risk of an unauthorized person taking control of the device.

This device cannot be connected directly to telecom lines (or public wireless networks) of any telecom service providers (i.e. mobile providers, landline providers or Internet providers). A router has to be used for the device Internet connection.

Recommendation: Use a secure network or private Wi-Fi protected with a strong password.




CAUTION

- We recommend the use of a LAN [surge protection](#) (p. 34).
- We recommend the use of a shielded SFTP Ethernet cable.

Grounding

To increase the static electricity resistance, you need a cable of the minimum cross-section of 4 mm². Connect the cable to the terminal in the bottom part of the device as shown in the figure below. The terminal is included in the delivery.

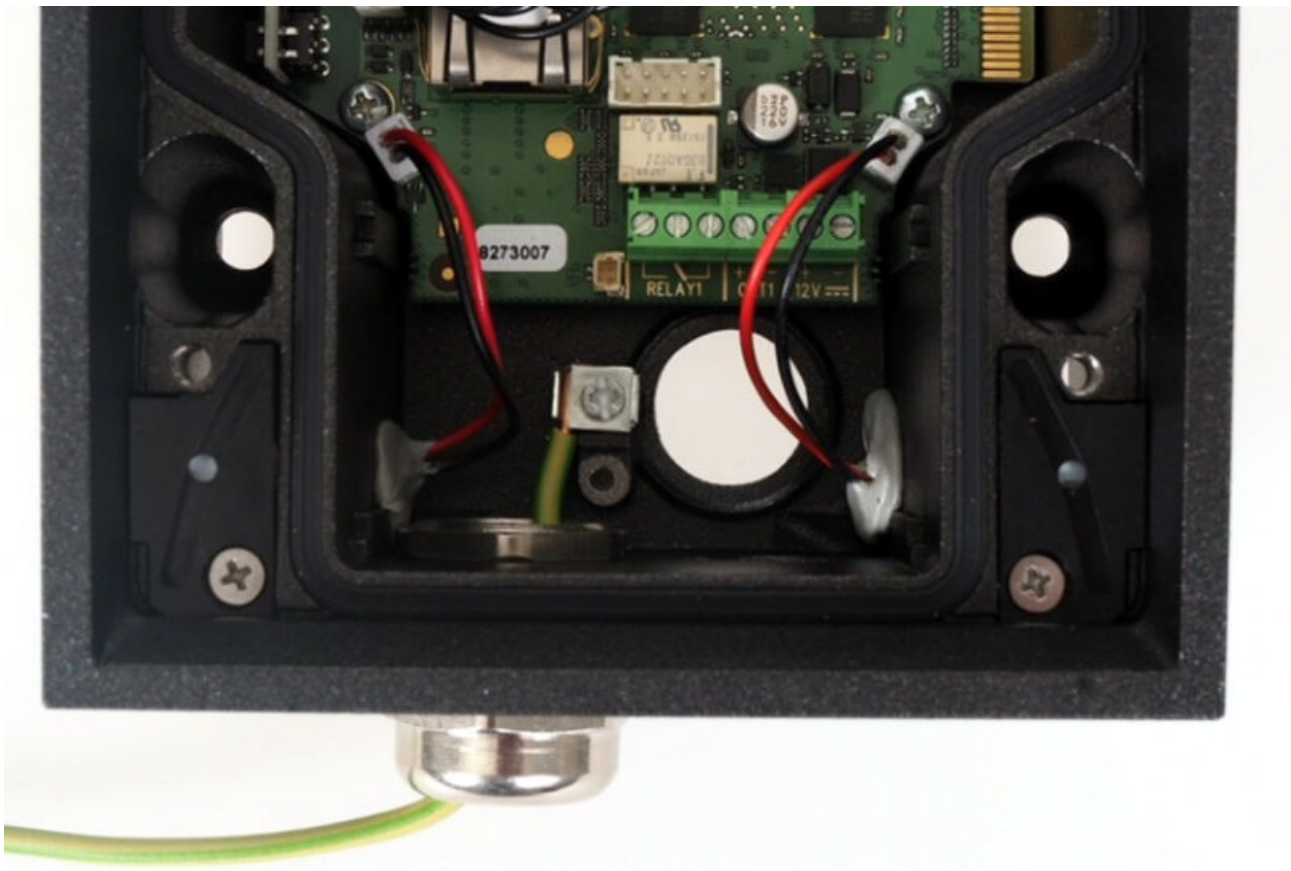

Overvoltage Protection


The 2N device cables have to be protected against atmospheric overvoltage caused by external causes (lightning, e.g.). A surge can damage a device installed outside/inside the building if the wires are unprotected.

Therefore, we recommend that additional overvoltage protectors (OVP) be installed on the outer walls or roof for all the wires leading outside the building. Keep the following instructions while installing overvoltage protectors:


- Make sure that the overvoltage protector is installed as close as possible to the device installed outside the building.
- Make sure that the overvoltage protector is installed as close as possible to the device installed on an external part of the building.
- Make sure that the overvoltage protector is installed as close as possible to the point where the cabling leaves the building.

Examples of Overvoltage Protection Installation


Overvoltage protection installation diagram for a device installed on the building facade and cables outside the building

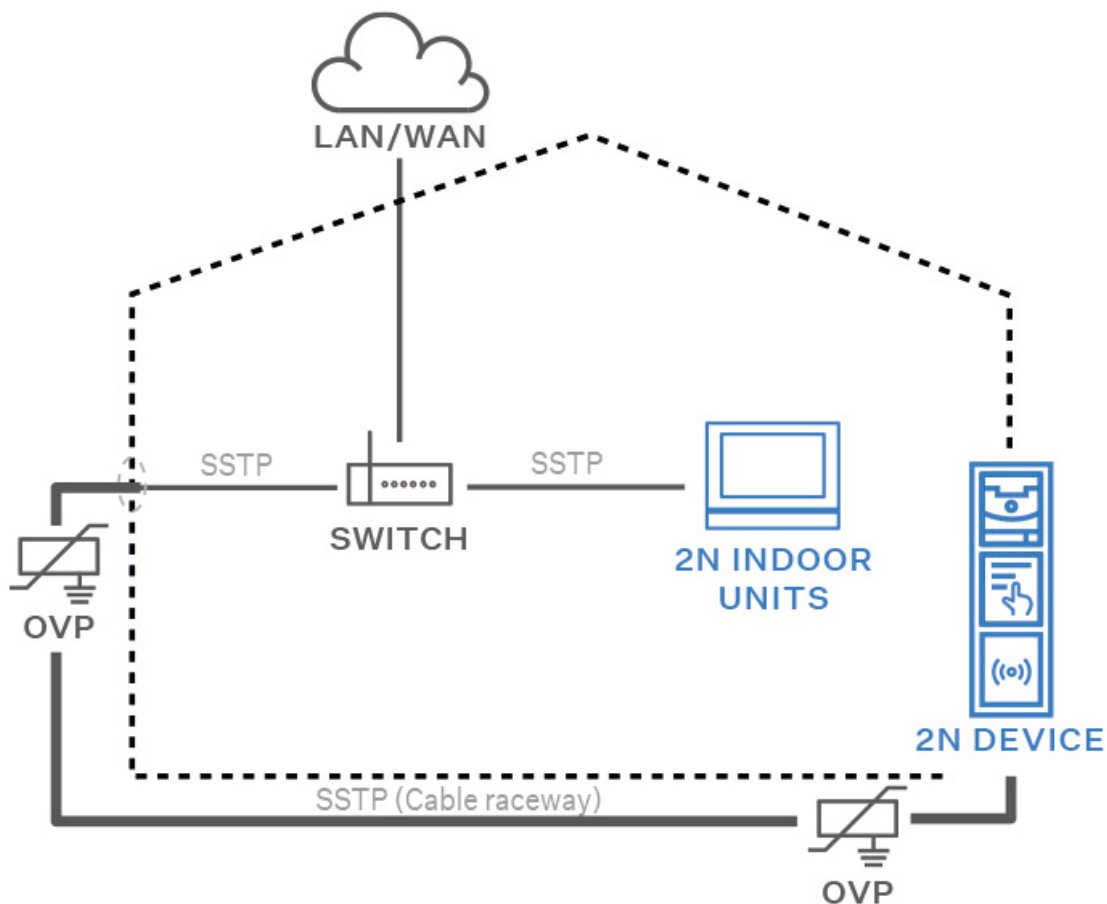

Overvoltage protection installation diagram for a device installed on the building facade and cables inside the building

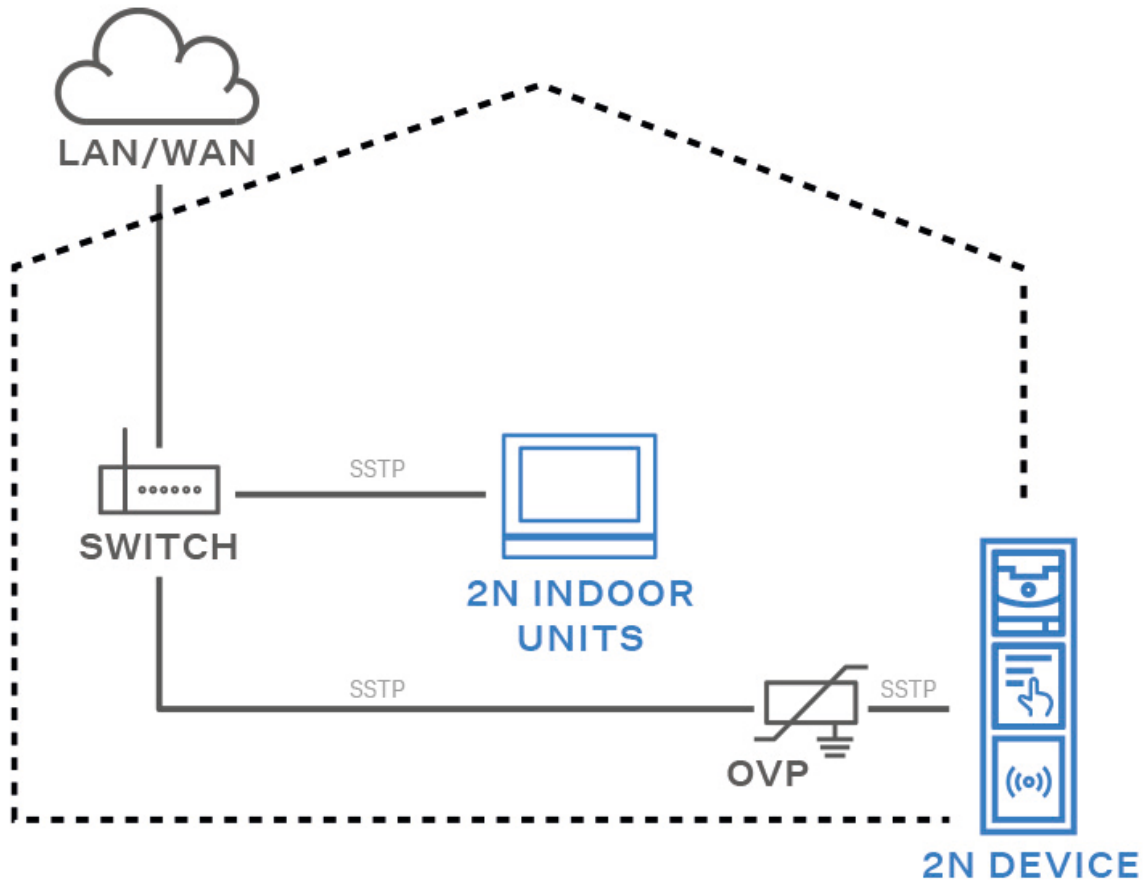

Overvoltage protection installation diagram for a device and cables installed outside the building

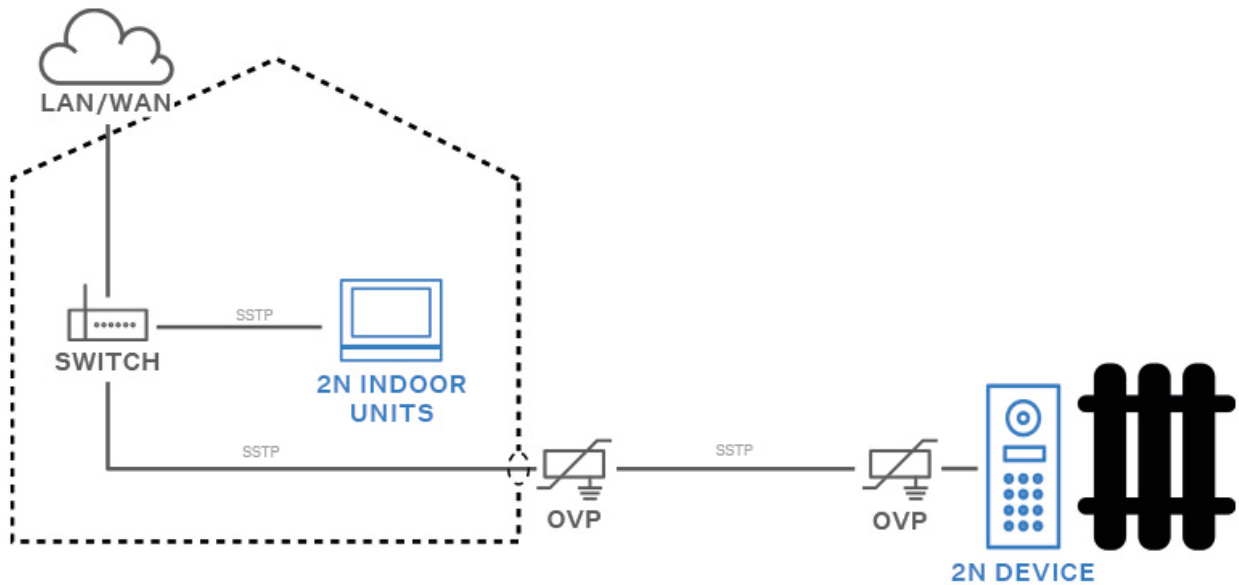

Main and Extending Modules



CAUTION

In case the firmware versions of the module to be connected and the main unit are incompatible, the module will not be detected. Therefore, update the device firmware after connecting the modules. Update firmware via the web configuration interface in System > Maintenance.

2N IP Safety can be interconnected with the following modules:

- Additional Switch
- [Induction Loop external \(p. 42\)](#)
- [Security Relay \(p. 40\)](#)

Additional Switch

The Additional Switch (Part No. 9151010, 01350-001) is used for extending the count of inputs/outputs.



CAUTION

If the Additional Switch is installed, it is not possible to install the Internal RFID Card Reader.

Features



- The **2N IP Safety** Additional Switch adds two additional switches, one logical input and a tamper switch to the main unit.
- The purpose of the tamper switch is to signal any unauthorized opening of the device (to prevent a theft, e.g.). It is recommended to use the tamper switch.




TIP

FAQ: [Tamper Switch - How to Connect It to 2N IP Intercom](#)

Installation

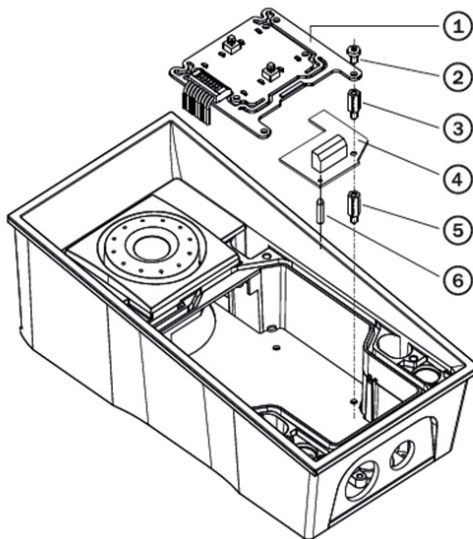

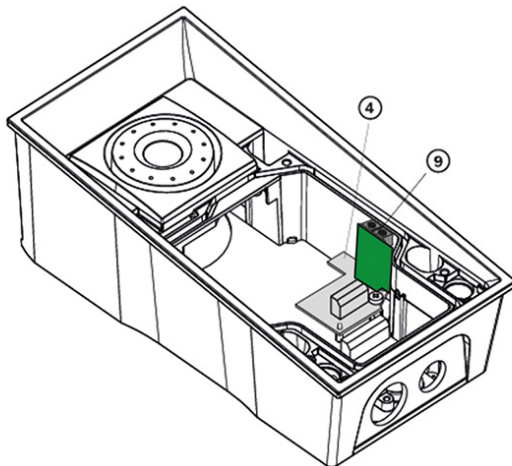


1. Turn off the device.
2. Remove the front panel from the device.
3. According to your model:
 - a. If you are mounting the switch into a two-nameplate model, demount the button PCB (1) and remove the right-hand bottom spacer (there are four PCB fitting spacers altogether).
 - b. If you are mounting the switch into a keypad model, take the keypad out of the holder. Demount the right-hand keypad holder - beam with a pin (8) – remembering its position. Demount the right-hand bottom spacer. Do not disconnect the button cable!
 - c. If you are mounting the switch into a model other than the two ones mentioned in items 3a and 3b above, remove the right-hand bottom screw from the motherboard.
4. Screw the enclosed 12 mm spacer (5) into the vacated motherboard slot.
5. Mount the enclosed plastic support (6) onto the switch board bottom side.
6. Put the switch board (4) in the motherboard connector. Make sure that the screw hole is directly above the spacer.
7. According to your model:
 - a. If you are mounting the switch into a two-nameplate model, fit the switch board with the enclosed 10.5 mm spacer (3) and reinstall the button PCB (1).
 - b. If you are mounting the switch into a keypad model, reinstall the beam (8) of the keypad holder (the pin is on the top). Insert the enclosed 4.5 mm washer (9) between the beam and the switch board, fitting the assembly with the 15 mm screw enclosed (7).
 - c. If you are mounting the switch into a model other than the two ones mentioned in items 7a and 7b, fit the switch board with the original 6 mm screw (2).
8. If you want to use the tamper switch, insert the tamper board (9) in the connector located in the right-hand bottom part of the switch board (4). As the tamper switch shares the RELAY2 NO and NC terminals, you cannot use the RELAY2 output and the tamper switch together.
9. Replace the front panel and tighten all the four screws.

Module Settings


Refer to the Configuration Manual for details.

Connection

Version 5

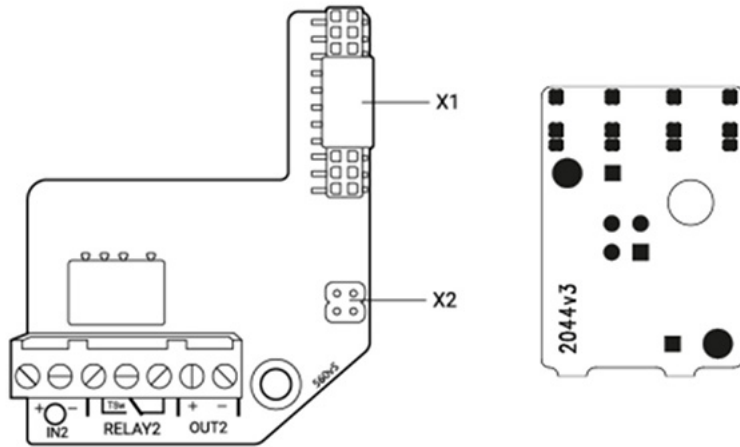

Version 4 and lower

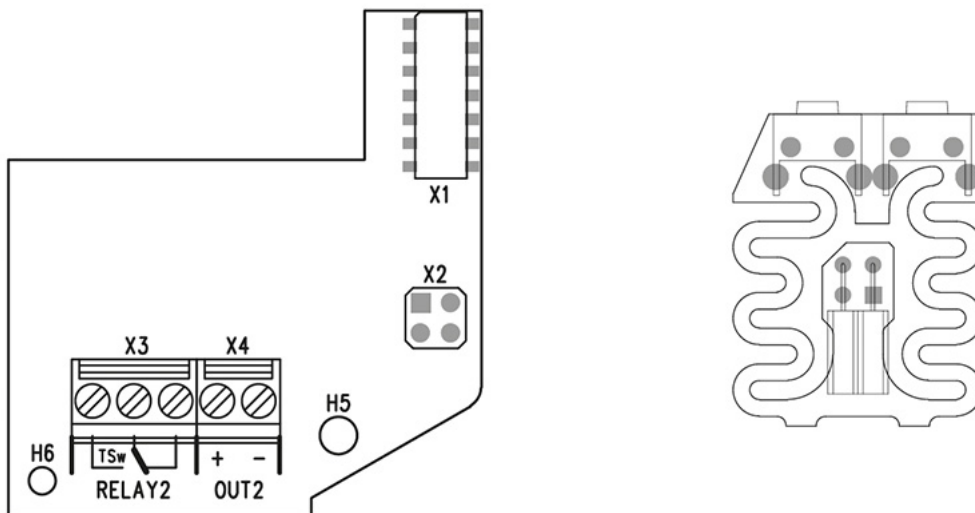

Security Relay

The Security Relay (9159010, 01386-001) is used for enhancing security between **2N IP Safety** and the connected electric lock. The Security Relay significantly enhances security of the connected electric lock by preventing unlocking due to device tampering.



TIP

FAQ: [2N Security Relay – description of the device and use with the 2N intercoms](#)

Specification

Passive switch	NO/NC contact, up to 30 V / 1 A AC/DC
----------------	---------------------------------------

Switched output	<ul style="list-style-type: none"> • Where the Security Relay is fed from the device, 8 to 12 V DC is available on the output depending on the power supply, 400 mA DC. <ul style="list-style-type: none"> • PoE: 10 V • adapter: source voltage of minus 2 V • Where the Security Relay is fed from an external power supply, 12 V / 700 mA DC is available on the output.
-----------------	--

Dimensions	66.5 × 32.5 × 20.5 mm
------------	-----------------------

Weight	24 g
--------	------


Connectors and Installation

The Security Relay is installed between the device (outside the secured area) and the electric lock (inside the secured area). The Security Relay includes a relay that can only be activated if a valid access card/code is detected on the unit.

The Security Relay is installed on a two-wire cable between the device and the electric lock inside the area to be secured (typically behind the door). The Security Relay is powered and controlled via this two-wire cable and can thus be added to an existing installation. Thanks to its compact dimensions, the device can be installed into a standard mounting box.

The Security Relay is designed with holes for surface anchoring. It is recommended that a screw of the diameter of 3 mm with a lens head of the diameter of 6 mm is used. Using a countersunk head may cause irreversible damage to the plastic cover!

1. **2N IP Safety**
2. Door lock
3. Departure button

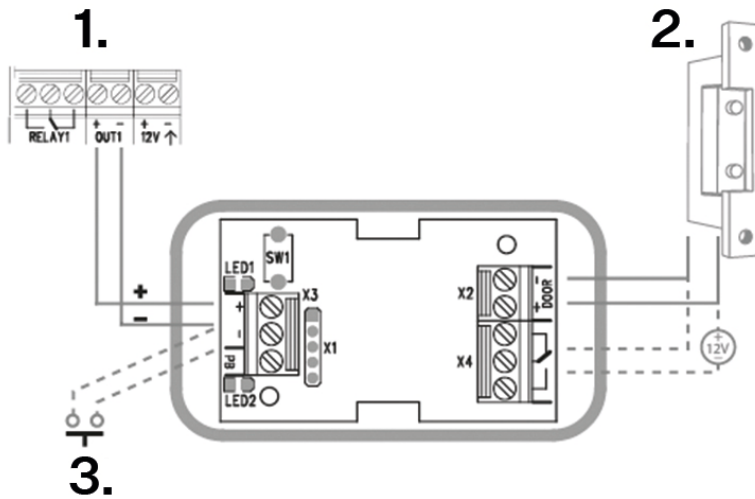

Connect the Security Relay to the access unit as follows:

- To the Active output

Connect the electric lock to the Security Relay as follows:

- to the switched output
- to the passive output in series with the external power supply

The Security Relay also supports the Departure button connected to the 'PB' and '- 2N IP intercom' terminals. Once the Departure button is pressed, the output is activated for 5 seconds.

<https://www.youtube.com/embed/ardukvQzw5A>

Status Signaling

Green LED	Red LED	State
flashing	off	Operational mode
on	off	Activated output
flashing	flashing	Programming mode – waiting for initialization
on	flashing	Error – wrong code

Configuration

1. Connect the Security Relay to the properly set Security output of the device. Refer to the Configuration Manual for details. Make sure that one LED at least is on or flashing.

2. Press and hold the Relay RESET button for 5 seconds to switch the device in the programming mode (red and green LEDs flashing).
3. Activate the output switch using the keypad, telephone, etc. The first code sent from the device will be stored in the memory and considered valid. After code initialization, the Security Relay will pass into the operational mode (green LED flashing).



CAUTION

Having reset the factory defaults on a device with firmware 2.18 or higher, remember to reprogram Security Relay using the instructions above.

Induction Loop external

External inductive loop (Inductive loop amplifier – Part No. 9159050, 01391-001, Inductive loop amplifier without accessories – Part No. 9159054, 12 V DC power adapter – Part No. 9159052, 01393-001) is used for reading RFID card IDs in the 13.56 MHz band, with NFC support. Provides communication between a connected OSDP device (control panel, door controller) and 2N device via the OSDP.

Specification

- Supply voltage: : 8–18 V DC
- Supply current at 12 V supply:
 - 1 Ω load, full power output; 1.4 A, sine wave signal; 1 A, pink noise signal
 - 8 Ω load, half power output; 550 mA, sine wave signal; 1.4 A, sine wave signal; 400 mA, pink noise signal
 - no signal; 100 mA
 - standby; max. 10 mA
- Switch to standby without signal: 10 s
- Basic input level: 100 mV – 6 V_{ef}
- Increased input level: 1 V – 35 V_{ef}
- Input impedance: 2 k Ω parallel with 0.3 H
- Output current, 1 Ω load: 2.2 A_{ef} (sine)
- Full power: 1.6 A_{ef} (pink noise)
- Output current, 8 Ω load: 730 mA_{ef} sine wave signal
- Half power: 520 mA_{ef} pink noise signal
- Output short-circuit resistance: unlimited time
- Frequency characteristics: 100 Hz – 5 KHz \pm 3 dB
- Temperature range: –20 to +50 °C
- Covering: IP65 (with round cable of 5–10 mm diameter)
- Dimensions: 144 x 100 x 31 mm
- Weight: 0.3 kg


Installation

The induction loop amplifier can be wall mounted with the use of an internal induction loop where a signal covering is requested. Outdoor use is possible thanks to the IP65 covering. A four-wire cable of the length of one meter is mounted to the supplied product for easier connection to the intercom. In the cable there are two wires for 12 V DC supply and two wires for signal input, the wires are connected into interconnection connector. If you shorten the cable, follow the color marking.

1. Before wall mounting the amplifier, run the cable through the hole that you have prepared. Indicate the position of the holes for installation, the two holes on the front.
2. Remove the amplifier and drill the mounting holes.

Installation


3. Use the plugs and screws included in the delivery. Use a drill of the diameter of 6 mm.
4. After fastening, cover the screws with the blanks supplied.
5. Use the supplied connectors to connect the amplifier to the intercom and power supply.
6. The A connector is connected to the amplifier four-wire cable.
7. Insert a special intercom-connecting cable supplied with the amplifier and 12 V power supply outlets to the B connector. Connect the special cable to the intercom and connect the power supply to the mains.
8. You can place the mated A and B connectors into the 2N device cover. The connectors help you connect stripped cables. Open the connector by pushing a thin screwdriver onto the white spots at its front and close the connector by sliding the movable part through a side gap.
9. Finally, test the amplifier function using a suitable receiver for hearing impaired persons or magnetic field communication tester. No other settings are required.

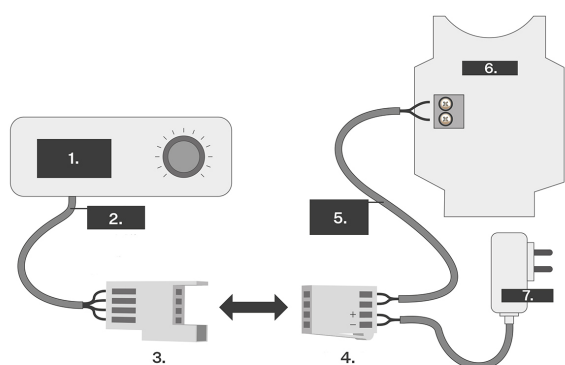

1. Amplifier with pre-installed cable
2. Four-wire cable
 - IN1 – brown
 - IN2 – white
 - +12 V – yellow
 - 0 V – green
3. Connector A
4. Connector B
5. Connecting cable
6. 2N intercom
7. Power supply

Grounding

To increase the static electricity resistance, you need a cable of the minimum cross-section of 4 mm². Connect the cable to the terminal in the bottom part of the device as shown in the figure below. The terminal is included in the delivery.

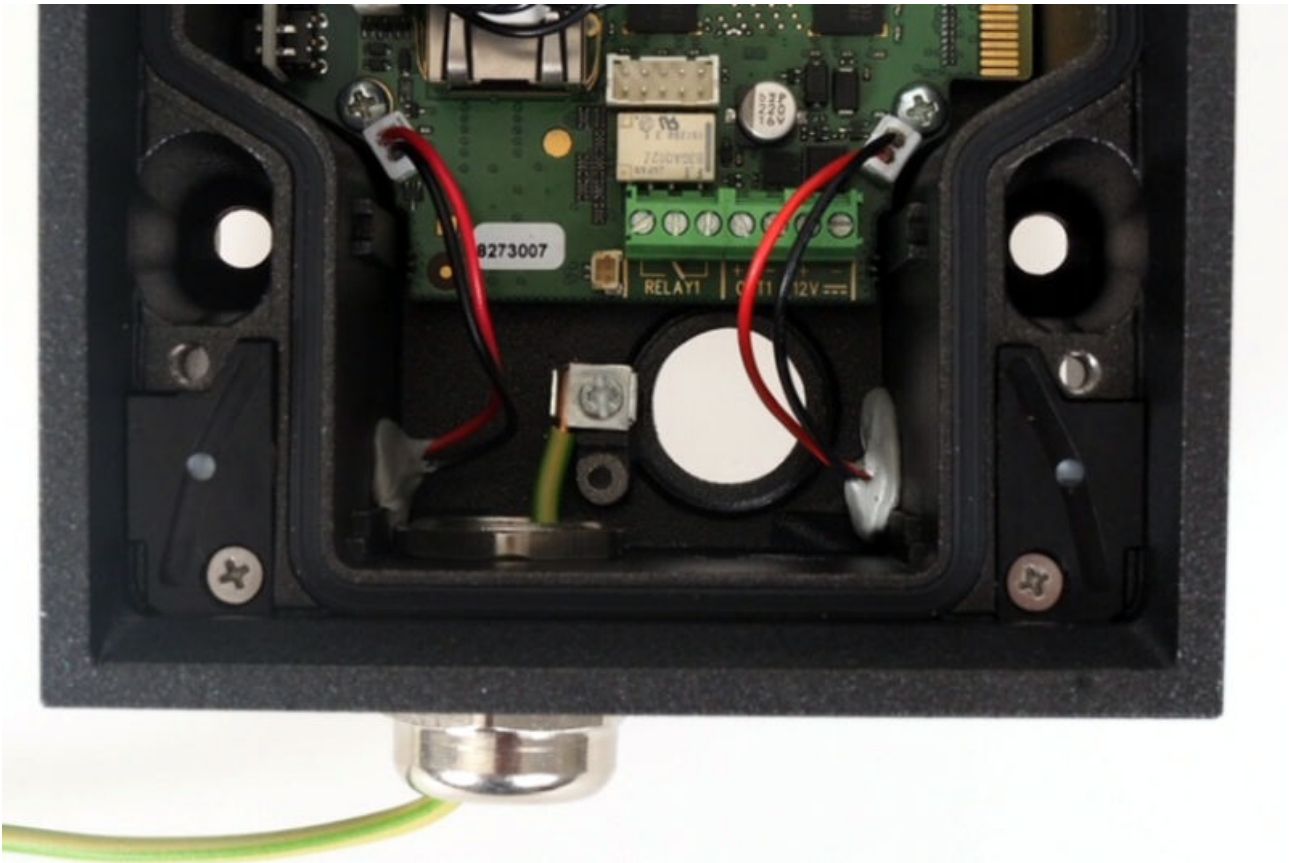

Installation Completion

1. Having connected all the wires, make sure that the bushings, if used, are tightened properly and the RJ-45 connector is inserted in the PCB connector.
2. Replace the front cover carefully. Make sure that the connector is inserted correctly and the wires inside the device leave enough space for the board if you are installing a four-button board. Tighten the four screws thoroughly to push the panel by about 1 mm to fit tightly to the metal chassis. You can use the wrench included in package for tightening (Torx 20). Keep the maximum tightening torque of 1.5 Nm.



WARNING

- Properly installed device is waterproof. An incorrectly made installation may compromise the device waterproofness. Water infiltration may damage the electronic part.
- Stainless steel screws are used for the **2N IP Safety** assembly. Other screws than stainless steel ones corrode soon and may aesthetically deteriorate the surrounding environment!

Brief Guidelines

Device Configuration Interface Access

2N IP Safety is configured via a web configuration interface. You have to know the device IP address or the device domain name. Make sure that the device is connected to the local IP network and powered.

Refer to the Configuration [Manual for 2N IP Intercoms](#) for the device configuration details.

Domain Name

Enter the device domain name as “hostname.local” to connect to the device. The hostname of a new device consists of the device name and serial number. Enter the serial number into the domain name without dashes. Change the hostname anytime in **System > Network**.

Default domain name 2N IP Safety: 2NIPSafety-{serial number without dashes}.local (e.g.: “2NIPSafety-0000000001.local”)

Login based on a domain name is advantageous if the dynamic IP address is used. While the dynamic IP address changes, the domain name remains the same. It is possible to generate certificates signed by a trusted certification authority for the domain name.

IP address

To retrieve the device IP address, take the following steps, see :

- Use the freely accessible 2N IP Utility.
- Use hardware (RESET button).
- Use the Speed Dial button.

Web Configuration Interface Login

1. Fill in the **2N IP Safety** address or domain name into the internet browser.

The login screen is now displayed.

Should the login screen fail to appear, make sure that you have typed the correct IP address, port or domain name. The login screen also does not appear when the administration web server is off. If you do not have a certificate generated for the IP address / domain name, an invalid security certificate warning may be displayed. In this case, you have to confirm that you want to go to the web configuration interface.

2. Enter the login data.

The default login data are:

Username: **Admin**

Password: **2n**

It is necessary to change the password immediately upon the first login.

After login using the default password, the access to the web configuration interface functions is limited.

**TIP**

It is recommended that a password is used that is difficult to break. It is not recommended that names, places or things, especially those closely related to the user, are used in the password.

For increased password security, it is recommended that:

- the random password generator is used,
- the password length is 12 characters at least,
- various characters from different character sets are combined (small/capital letters, digits, special characters, etc.).

Recommended browsers

The web configuration interface is optimized for the Chromium-based web browsers (Google Chrome, Microsoft Edge or Opera, e.g.). With other browsers, there may be slight differences in the interface function and appearance.

Configuration via Hardware


The RESET button helps you reset the factory default values, restart the device, retrieve the device IP address and switch the IP address static/dynamic mode.


Device Restart

Press the button shortly (< 1 s) to restart the system without changing configuration.

IP Address Retrieval Using Hardware

Follow the instructions below to retrieve the current IP address:

1. Press the button RESET and keep it pressed.
 - a. Wait until the red and green LEDs go on simultaneously on the device and the acoustic signal can be heard  (approx. 15–35 s).
2. Release the RESET button.
3. The device announces the current IP address via the speaker automatically.

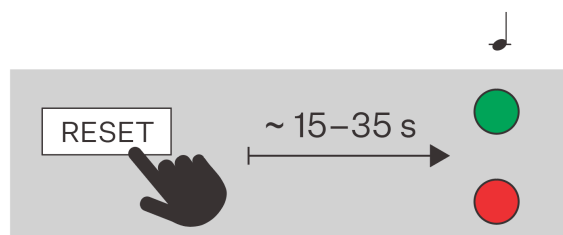
**NOTE**

The delay after pressing RESET till the first light and sound signaling is set to 15–35 s depending on the device model used.

Static IP Address Setting with RESET Button

Follow the instructions below to switch on the Static IP address mode (DHCP OFF):

1. Press the button RESET and keep it pressed.
 - a. Wait until the red and green LEDs go on simultaneously on the device and the acoustic signal can be heard 🗣️ (approx. 15–35 s).
 - b. Wait until the red LED goes off and an acoustic signal can be heard 🗣️ (approx. for another 3 s).
2. Release the RESET button.

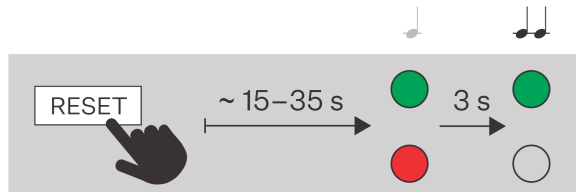

NOTE


The following network parameters will be set after restart:

- IP address: 192.168.1.100
- Network mask: 255.255.255.0
- Default gateway: 192.168.1.1

Dynamic IP Address Setting via RESET

Follow the instructions below to switch on the Static IP address mode (DCHP ON):



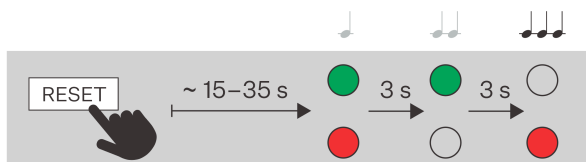

1. Press the button RESET and keep it pressed.
 - a. Wait until the red and green LEDs go on simultaneously on the device and the acoustic signal can be heard 🗣️ (approx. 15–35 s).
 - b. Wait until the red LED goes off and an acoustic signal can be heard 🗣️ (approx. for another 3 s).
 - c. Wait until the green LED goes off and the red LED goes on again and an acoustic signal can be heard 🗣️ (approx. for another 3 s).
2. Release the RESET button.




**NOTE**

The default network parameters will be set after restart.

Factory Default Reset with RESET Button

1. Press the button RESET and keep it pressed.
 - a. Wait until the red and green LEDs go on simultaneously on the device and the acoustic signal can be heard  (approx. 15–35 s).
 - b. Wait until the red LED goes off and an acoustic signal can be heard  (approx. for another 3 s).
 - c. Wait until the green LED goes off and the red LED goes on again and an acoustic signal can be heard  (approx. for another 3 s).
 - d. Wait until the red LED goes off and the acoustic signal can be heard  (approx. for another 3 s).
2. Release the RESET button.

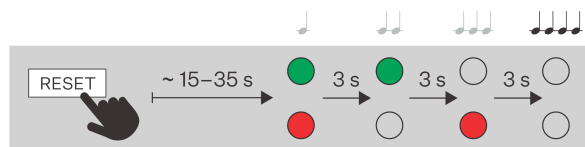

IP Address Retrieval

To retrieve the device IP address, take the following steps:


- Use the freely accessible 2N IP Utility.
- Use hardware (RESET button).
- Use the Speed Dial button.

IP Address Retrieval Using 2N IP Utility

The 2N IP Utility application helps find the 2N device IP address in the LAN. Download 2N IP Utility from the [2N.com](https://www.2n.com) website. Make sure that Microsoft .NET Framework 4.7.2 is installed for successful app installation.

1. Run the 2N IP Utility installer.
2. The Installation Wizard will help you with the installation.

- Having installed 2N IP Utility, start the application using the Microsoft Windows Start menu. Once started, the application begins to automatically search the LAN for all the 2N and AXIS devices which have been DHCP/statically assigned IP addresses. These devices are then shown in a table.

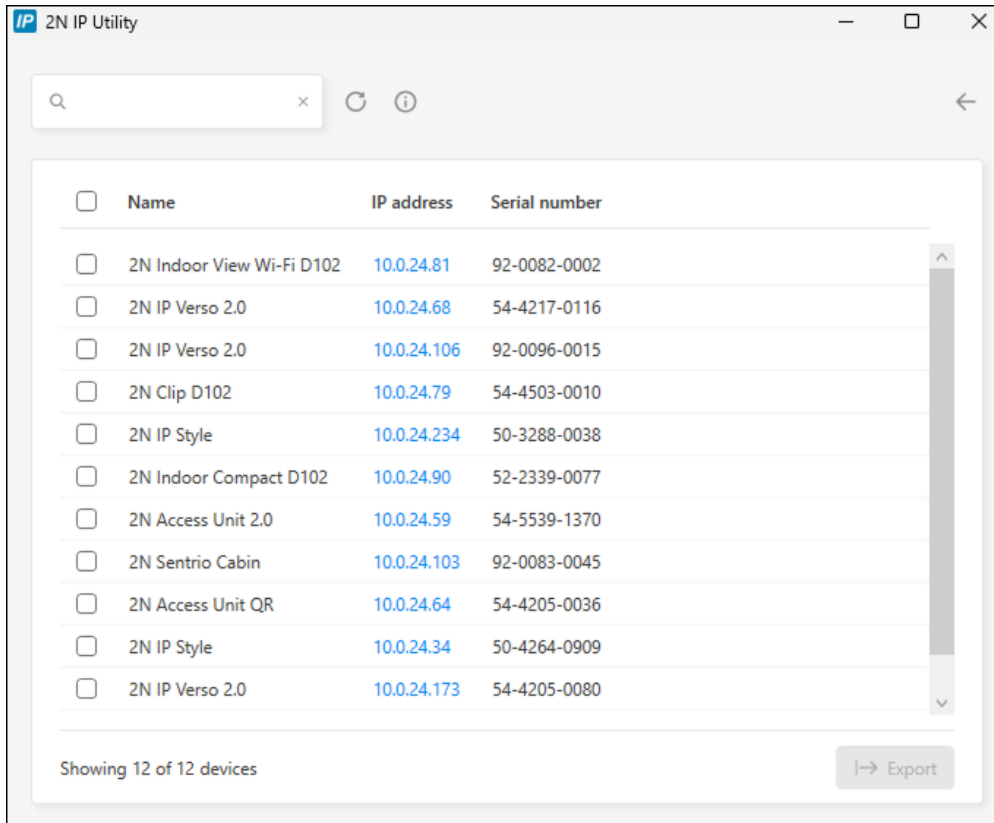

- Select the device to be configured and left-click it. This opens the right-hand part of the web configuration interface window.



TIP

- Access to the web configuration interface is also possible via the **Open in external browser** button, which opens the interface in a separate browser window.
- Click a device in the list to display detailed information. Click the **IP settings** button to change the IP address by entering the required static IP address or activating DHCP.
- The application also allows you to export selected devices into a CSV file. First select a device by ticking the boxes in the list, then use the **Export** button that appears at the bottom of the window. The exported file shall include the names, IP addresses and serial numbers of the selected devices.

The default login data are:

Username: **Admin**

Password: **2n**

It is necessary to change the password immediately upon the first login.

**TIP**

It is recommended that a password is used that is difficult to break. It is not recommended that names, places or things, especially those closely related to the user, are used in the password.


For increased password security, it is recommended that:

- the random password generator is used,
- the password length is 12 characters at least,
- various characters from different character sets are combined (small/capital letters, digits, special characters, etc.).

IP Address Retrieval Using Hardware

Follow the instructions below to retrieve the current IP address:

1. Press the button RESET and keep it pressed.
 - a. Wait until the red and green LEDs go on simultaneously on the device and the acoustic signal can be heard (approx. 15–35 s).
2. Release the RESET button.
3. The device announces the current IP address via the speaker automatically.

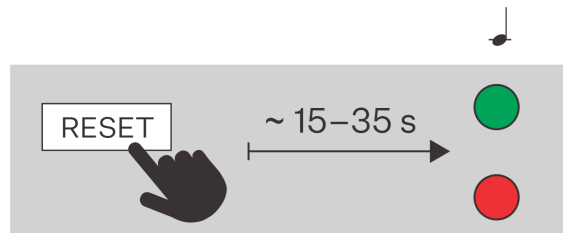**NOTE**

The delay after pressing RESET till the first light and sound signaling is set to 15–35 s depending on the device model used.

IP Address Retrieval Using Speed Dial Button

Take the following steps to retrieve the **2N IP Safety** IP address:

1. Connect the device to the power supply (if connected, disconnect and reconnect it).
2. Press the Quick dial button 5 times on the main unit.
3. The device reads its IP address.

**NOTE**

- If the address is 0.0.0.0, it means that the device has not obtained the IP address from the DHCP server.
- Press the button sequence within 30 seconds after the sound signal for security reasons. Up to 2 s intervals are allowed between the presses.

Device Static/Dynamic IP Address Switching with Speed Dial Button

Take the following steps to reset the network settings and switch the static IP address (DHCP OFF) / dynamic IP address (DHCP OFF) mode in the device network configuration:

1. Connect the device to the power supply (if connected, disconnect and reconnect it).
2. Press the Speed dial button 15 times on the main unit.

**NOTE**

After the static address mode is switched on, the basic network parameters are reset to the following default values:

- IP address: 192.168.1.100
- Network mask: 255.255.255.0
- Default gateway: 192.168.1.1

Device Restart

To restart the device choose one of the following options:

- using the RESET button,
- via the web configuration interface.

**NOTE**

The device restart does not result in any change in the configuration settings.

Restart Using RESET Button

Press the button shortly (< 1 s) to restart the system without changing configuration.

Restart Using Web Configuration Interface

You can restart the device via the web configuration interface. Refer to [Web Configuration Interface Login \(p. 45\)](#) for login details. Restart the device in System > Maintenance > System using **Restart device**.

Firmware Update

We recommend that the firmware is also updated during the **2N IP Safety** installation. Refer to [2N.com](#) for the latest FW version.

Update firmware via the web configuration interface in System > Maintenance, refer to the device Configuration Manual.

Once the firmware is uploaded successfully, the device is restarted automatically.




TIP

You can make bulk updates for multiple devices via 2N Access Commander.

Factory Default Reset with RESET Button

1. Press the button RESET and keep it pressed.
 - a. Wait until the red and green LEDs go on simultaneously on the device and the acoustic signal can be heard 🗣️ (approx. 15–35 s).
 - b. Wait until the red LED goes off and an acoustic signal can be heard 🗣️ (approx. for another 3 s).
 - c. Wait until the green LED goes off and the red LED goes on again and an acoustic signal can be heard 🗣️🗣️ (approx. for another 3 s).
 - d. Wait until the red LED goes off and the acoustic signal can be heard 🗣️🗣️🗣️ (approx. for another 3 s).
2. Release the RESET button.

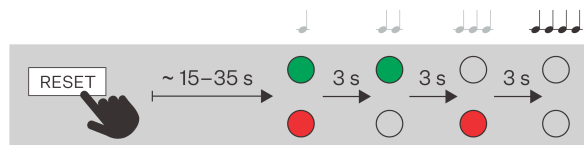

Factory Default Reset (version 555v3)

For resetting device to default settings press and hold SW1 button. Wait for the first sound signalization and then release the button. If you press the button for short time device will reboot only.



WARNING


Having reset the factory defaults on a device with firmware 2.18 or higher, remember to reprogram Security Relay using the instructions above.

Factory Default Reset (version 555v2)


1. Disconnect the device from the power supply.
2. Move the short-circuit jumper on connector X6 into the Default setup position. Configuration jumpers (X6) are located in the right-hand upper corner of the PCB.
3. Reconnect the power supply and wait for a start signalling sound.
4. Disconnect the device from the power supply.

5. Move the short-circuit jumper on connector X6 into the Normal operation position.
6. Reconnect the power supply. The device will be reset to factory default.

Configuration jumpers X6, PCB version 555v2 – Normal Operation

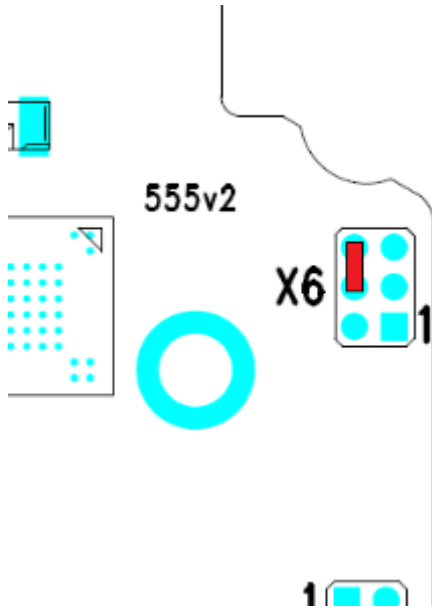

Configuration jumpers X6, PCB version 555v2 – Factory Reset

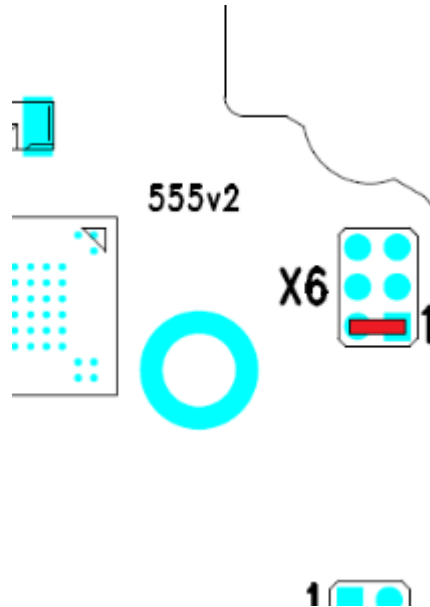

WARNING

Having reset the factory defaults on a device with firmware 2.18 or higher, remember to reprogram Security Relay using the instructions above.

Call Connection


To make calls with other terminal devices in IP networks, it is necessary to assign the device to a contact in the Directory.

Connection with 2N Devices in LAN

1. Make sure that Local calls is enabled on both the 2N devices.
2. Click **Find device** above the table. Check the listed device that you want to establish connection to. Once the device is added, editing becomes available.
3. Edit the following:
 - a virtual number to start a call by entering the number via your numerical keypad
 - basic information and access options for the device user
4. To dial calls using a device button, assign the selected user to the speed dial button in **Calls > Dialing**, refer to Speed dial buttons.
5. Make sure that Local calls is enabled on the called 2N device to make a successful call.

Connection with Other Devices

1. Click **Add user** or open the existing contact detail to create a new contact.

2. Click the pencil icon next to the Phone number  to open phone number editing.
3. Enter the calling destination address into the destination field to which the call is to be routed. Complete the target IP address or SIP URI in the format “ user_name@host” (e.g.: “johana@2.255.4.255” or “johana@calls.2N.com”). For local calls, fill in the called 2N device ID as specified in the Local calls tab in the called device web configuration interface.
4. Edit the following:
 - a virtual number to start a call by entering the number via your numerical keypad
 - basic information and access options for the device user
5. To dial calls using a device button, assign the selected user to the speed dial button in **Calls > Dialing**, refer to Speed dial buttons.
6. Make sure that the call transmitting service is enabled on the called 2N device to make a successful call.



TIP

- Each user can be assigned up to 3 phone numbers. In case the first user fails to answer, the call is forwarded to the next number. Alternatively, you can set calling to multiple phone numbers simultaneously. Check Call in group between the selected numbers to set such multiple phone number calling for one user.
- In case all the user phone numbers are unavailable, you can set call forwarding to **Deputy**.
- Users can be gathered in calling groups. The calling group name is shown in the phone book on the device display. You can assign a calling group to a quick dial button. To terminate an outgoing group call after the first rejection from any of the called users, set this function in Calls > General Settings.

Troubleshooting

Refer to <https://www.2n.com/faqs> for the most frequently solved problems.

Technical Parameters

Power supply types

PoE IEEE PoE 802.3af (Class 0, max. 12,95 W) (Class 0, max. 12.95 W)

External supply 12 V / 1 A DC

Signaling protocol

SIP UDP, TCP, TLS

Buttons

Button design

Industrial waterproof, vandal resistant, stainless steel, blue backlit pushbutton

Button count

1 (2 on request)

Numeric Keypad

Custom built

Audio

Microphone

2 integrated

Amplifier

10 W (class D)

Speaker

10 W

Sound pressure level (SPL max)

78.5 dB (1 W model, for 1 kHz at 1 m); 94 dB \pm 3 % (10 W model, for 1 kHz at 1 m)

Technical Parameters

Audio

Volume Control	Adjustable with automatic adaptive mode
Full duplex	Yes (AEC)

Audio stream

Protocols	<ul style="list-style-type: none">• RTP• RTSP
Codecs and Used Bandwidth	<ul style="list-style-type: none">• G.711 (PCMA, PCMU) – 64 kbps (with 85.6 kbps headers)• G.729 – 16 kbps (with 29.6 kbps headers)• G.722 – 64 (with 85.6 kbps headers)• L16/16kHz – 256 kbps (with 277.6 kbps headers)

Video stream

Protocols	<ul style="list-style-type: none">• RTP• RTSP• HTTP
ONVIF/RTSP streaming codecs	<ul style="list-style-type: none">• H.264• MPEG-4• MJPEG
IP Camera Function	Yes – compatible profiles: <ul style="list-style-type: none">• ONVIF v2.4 profile S

Interface

LAN	10/100BASE-TX with Auto-MDIX, RJ-45
Recommended cabling	Cat-5e or higher
Supported protocols	SIP2.0, DHCP opt. 66, SMTP, 802.1x, RTSP, RTP, TFTP, HTTP, HTTPS, Syslog, ONVIF

Technical Parameters

Interface



Passive switch (relay)	NO/NC contact, up to 30 V / 1 A AC/DC
Active switch output	8 to 12 V DC according to power supply, up to 600 mA <ul style="list-style-type: none">• PoE: 10 V• adapter: source voltage –2 V

Mechanical Parameters




Cover	Robust aluminum cast product	
	Color: <ul style="list-style-type: none">• RAL 2004 orange	
Front Panel	Aluminum cast <ul style="list-style-type: none">• Fiberglass FR4	
Weight (depending on configuration)	Max. net	2 kg
	Max. gross	2.5 kg
Operating temperature	–40 °C to 55 °C	
Relative humidity	10 to 95 % (non-condensing)	
Storing temperature	–40 °C to 70 °C	
Recommended altitude	up to 2000 m	
Protection class	IP65, IP69K (91521xxxW), NEMA X4	
Resistance level	IK10	

General Drawings




Surface Installation

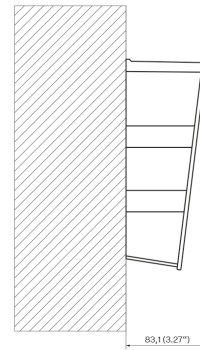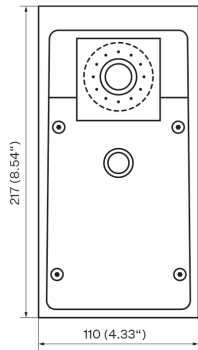

Flush mounting – into plasterboard

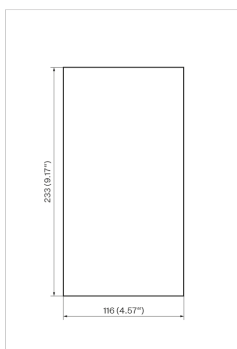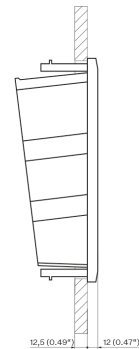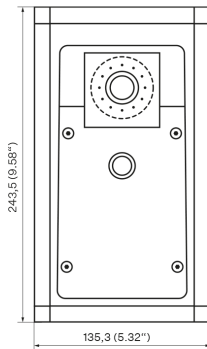

Flush mounting – into classic masonry

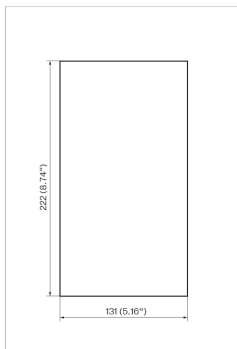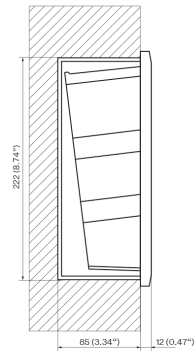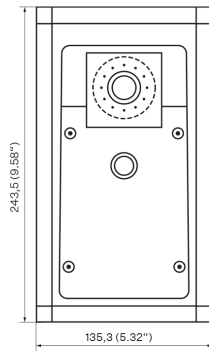

General Instructions and Cautions

Please read this User Manual carefully before using the product and follow the instructions and recommendations included therein.

Any use of the product that is in contradiction with the instructions provided herein may result in malfunction, damage or destruction of the product.

The manufacturer shall not be liable and responsible for any damage incurred as a result of a use of the product other than that included herein, namely undue application and disobedience of the recommendations and warnings.

Any use or connection of the product other than those included herein shall be considered undue and the manufacturer shall not be liable for any consequences arisen as a result of such misconduct.

Moreover, the manufacturer shall not be liable for any damage or destruction of the product incurred as a result of misplacement, incompetent installation and/or undue operation and use of the product in contradiction herewith.

The manufacturer assumes no responsibility for any malfunction, damage or destruction of the product caused by incompetent replacement of parts or due to the use of reproduction parts or components.

The manufacturer shall not be liable and responsible for any loss or damage incurred as a result of a natural disaster or any other unfavorable natural condition.

The manufacturer shall not be held liable for any damage of the product arising during the shipping thereof.

The manufacturer shall not make any warrant with regard to data loss or damage.

The manufacturer shall not be liable and responsible for any direct or indirect damage incurred as a result of a use of the product in contradiction herewith or a failure of the product due to a use in contradiction herewith.

All applicable legal regulations concerning the product installation and use as well as provisions of technical standards on electric installations have to be obeyed. The manufacturer shall not be liable and responsible for damage or destruction of the product or damage incurred by the consumer in case the product is used and handled contrary to the said regulations and provisions.

The consumer shall, at its own expense, procure software protection of the product. The manufacturer shall not be held liable for any damage incurred as a result of the use of deficient security software.

The consumer shall, without delay, change the access password for the product after installation. The manufacturer shall not be held liable or responsible for any damage incurred in connection with the use of the original password.

The manufacturer also assumes no responsibility for additional costs incurred by the consumer as a result of making calls to increased tariff lines.

Directives, Laws and Regulations

2N IP Safety conforms to the following directives and regulations:

EU

- 2012/19/EU on waste electrical and electronic equipment


- 2014/30/EU for electromagnetic compatibility
- 2014/35/EU for electrical equipment designed for use within certain voltage limits
- 2011/65/EU on the restriction of the use of certain hazardous substances in electrical and electronic equipment

Industry Canada


This Class B digital apparatus complies with Canadian ICES-003/NMB-003.

Legislation of Thailand

เครื่องโทรคมนาคมและอุปกรณ์นี้
มีความสอดคล้องตามมาตรฐานหรือขอ
กำหนดทางเทคนิคของ กสทช.


nab.

เครื่องวิทยุคมนาคมนี้ ได้รับยกเว้น ไม่ต้องได้
รับใบอนุญาตให้มี ใช้ซึ่งเครื่องวิทยุคมนาคม
หรือตั้งสถานีวิทยุคมนาคมตามประกาศ กสทช.
เรื่อง เครื่องวิทยุคมนาคม และสถานีวิทยุ
คมนาคมที่ได้รับยกเว้นไม่ต้องได้รับใบอนุญาต
วิทยุคมนาคมตามพระราชบัญญัติวิทยุคมนาคม
พ.ศ. 2498



nab. | โทรคมนาคม
กำกับดูแลเพื่อประชาชน
Call Center 1200 (InSW)

Legislation of Japan

この装置は、クラス B 機器です。この装置は、住宅環境で使用この装置は、クラス B 機器です。この装置は、住宅環境で使用するを目的としていますが、この装置がラジオやテレビジョン受信機に近接して使用されると、受信障害を引き起こすことがあります。取扱説明書に従って正しい取り扱いをして下さい。
VCCI - B

本製品は、シールドネットワークケーブル(STP)を使用して接続してください。また適切に接地してください。

本製品は電気通信事業者 (移動通信会社、固定通信会社、インターネットプロバイダ等) の通信回線 (公衆無線 LAN を含む) に直接接続することができません。本製品をインターネットに接続する場合は、必ずルータ等を経由し接続してください。

Electric Waste and Used Battery Pack Handling



Do not place used electric devices and battery packs into municipal waste containers. An undue disposal thereof might impair the environment!

Deliver your expired household electric appliances and battery packs removed from them to dedicated dumpsites or containers or give them back to the dealer or manufacturer for environmental-friendly dispos-

General Instructions and Cautions

a). The dealer or manufacturer shall take the product back free of charge and without requiring another purchase. Make sure that the devices to be disposed of are complete.

Do not throw battery packs into fire. Battery packs may not be taken into parts or short-circuited either.



2N IP Safety – Installation Manual

© 2N Telekomunikace a. s., 2026

2N.com